




VETERAN TREES IDENTIFIED BY THE DETAILED TREE SURVEY PLAN

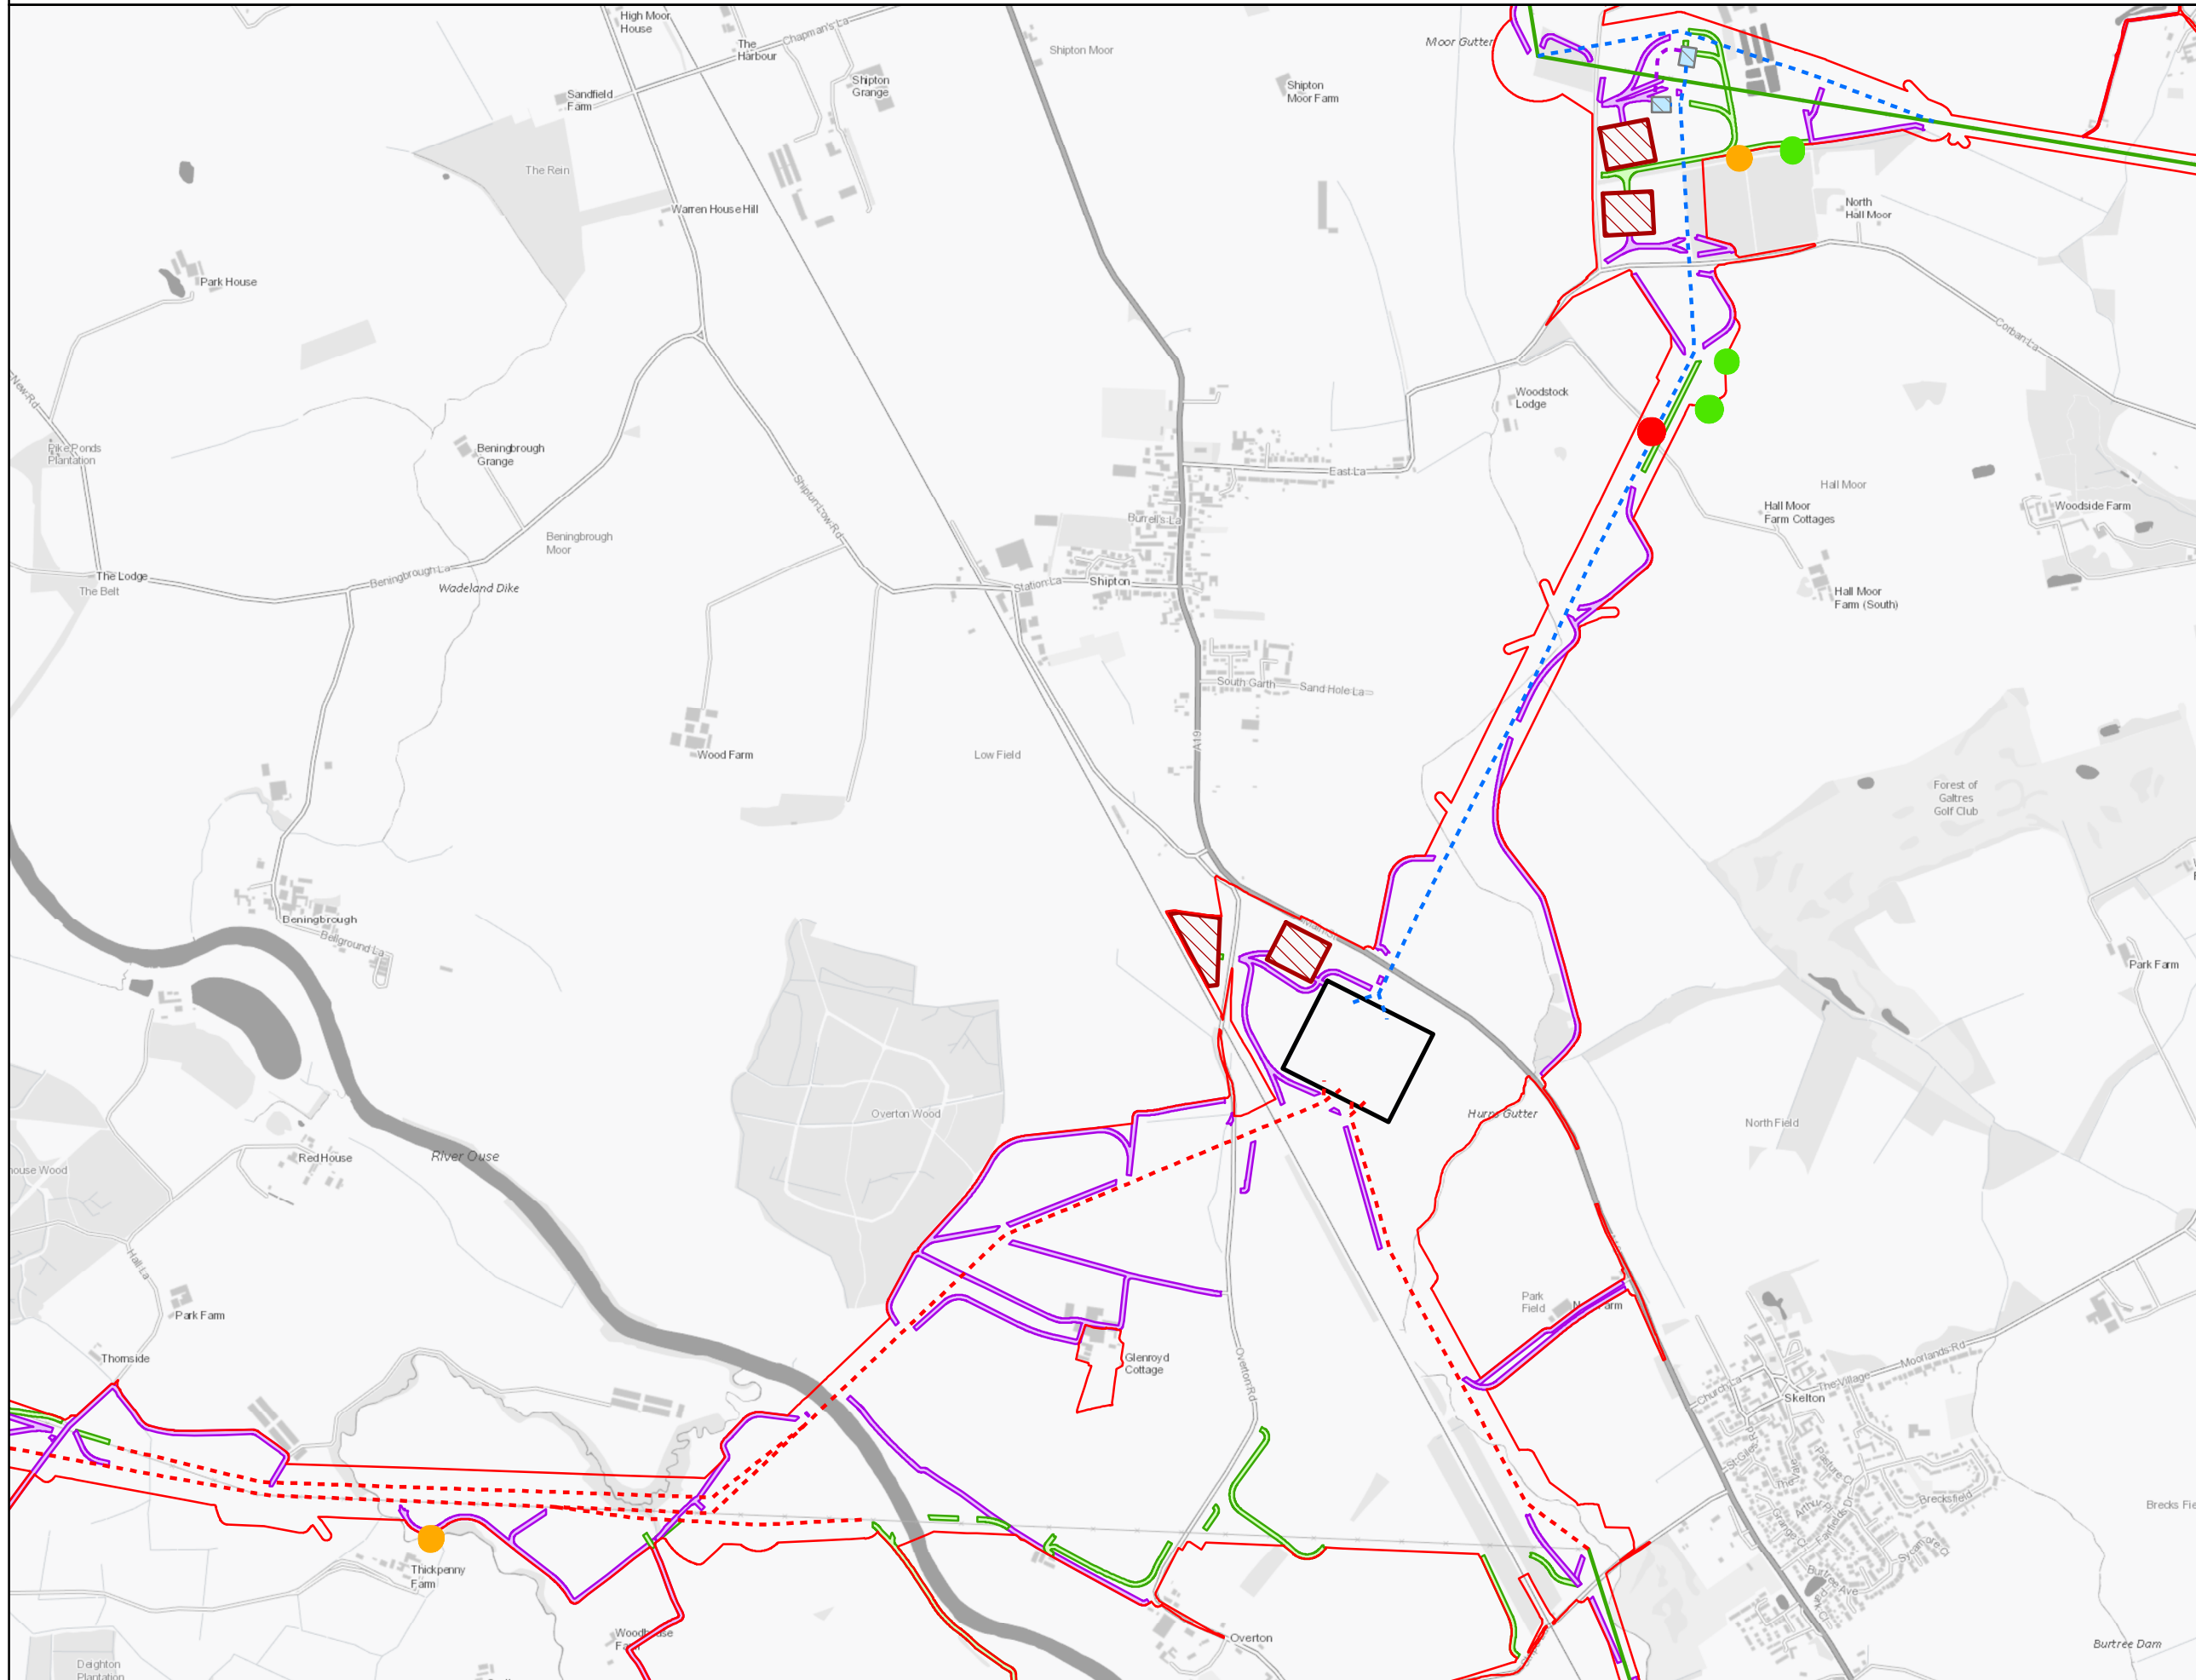


Legend

- Draft Order Limits
- 275kV OHL
- 400kV OHL
- 400kV UGC
- Existing OHL
- Substation
- Construction compound
- CESC area
- Indicative accesses**
- Permanent
- Temporary
- Veteran trees likely to be removed
- Potentially removed or impacted veteran trees
- Retained veteran trees

Notes
This drawing is scaled at paper size A3, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.



Coordinate System: British National Grid
Sheet X Centroid Coordinate: 455,104.85 Sheet Y Centroid Coordinate: 457,914.28



BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. © CROWN COPYRIGHT ORDNANCE SURVEY. NATIONAL GRID ELECTRICITY - 100024241. NATIONAL GRID GAS - 100024886.

1	SEP 21		COLLJ	DIMMR	CHADC
Issue	Date	Remarks	Drawn	Checked	Approved

Title

PRELIMINARY ENVIRONMENTAL INFORMATION REPORT
TREE LOSS / IMPACT ASSESSMENT FOR PEIR
VETERAN TREES IDENTIFIED BY THE DETAILED TREE SURVEY PLAN



Figure Number
FIGURE 2

Drawing Reference
806503-WOOD-0134

Scale 1:17,000	Sheet Size A3	Sheet SHEET 1 OF 1	Issue 1
--------------------------	-------------------------	------------------------------	-------------------