



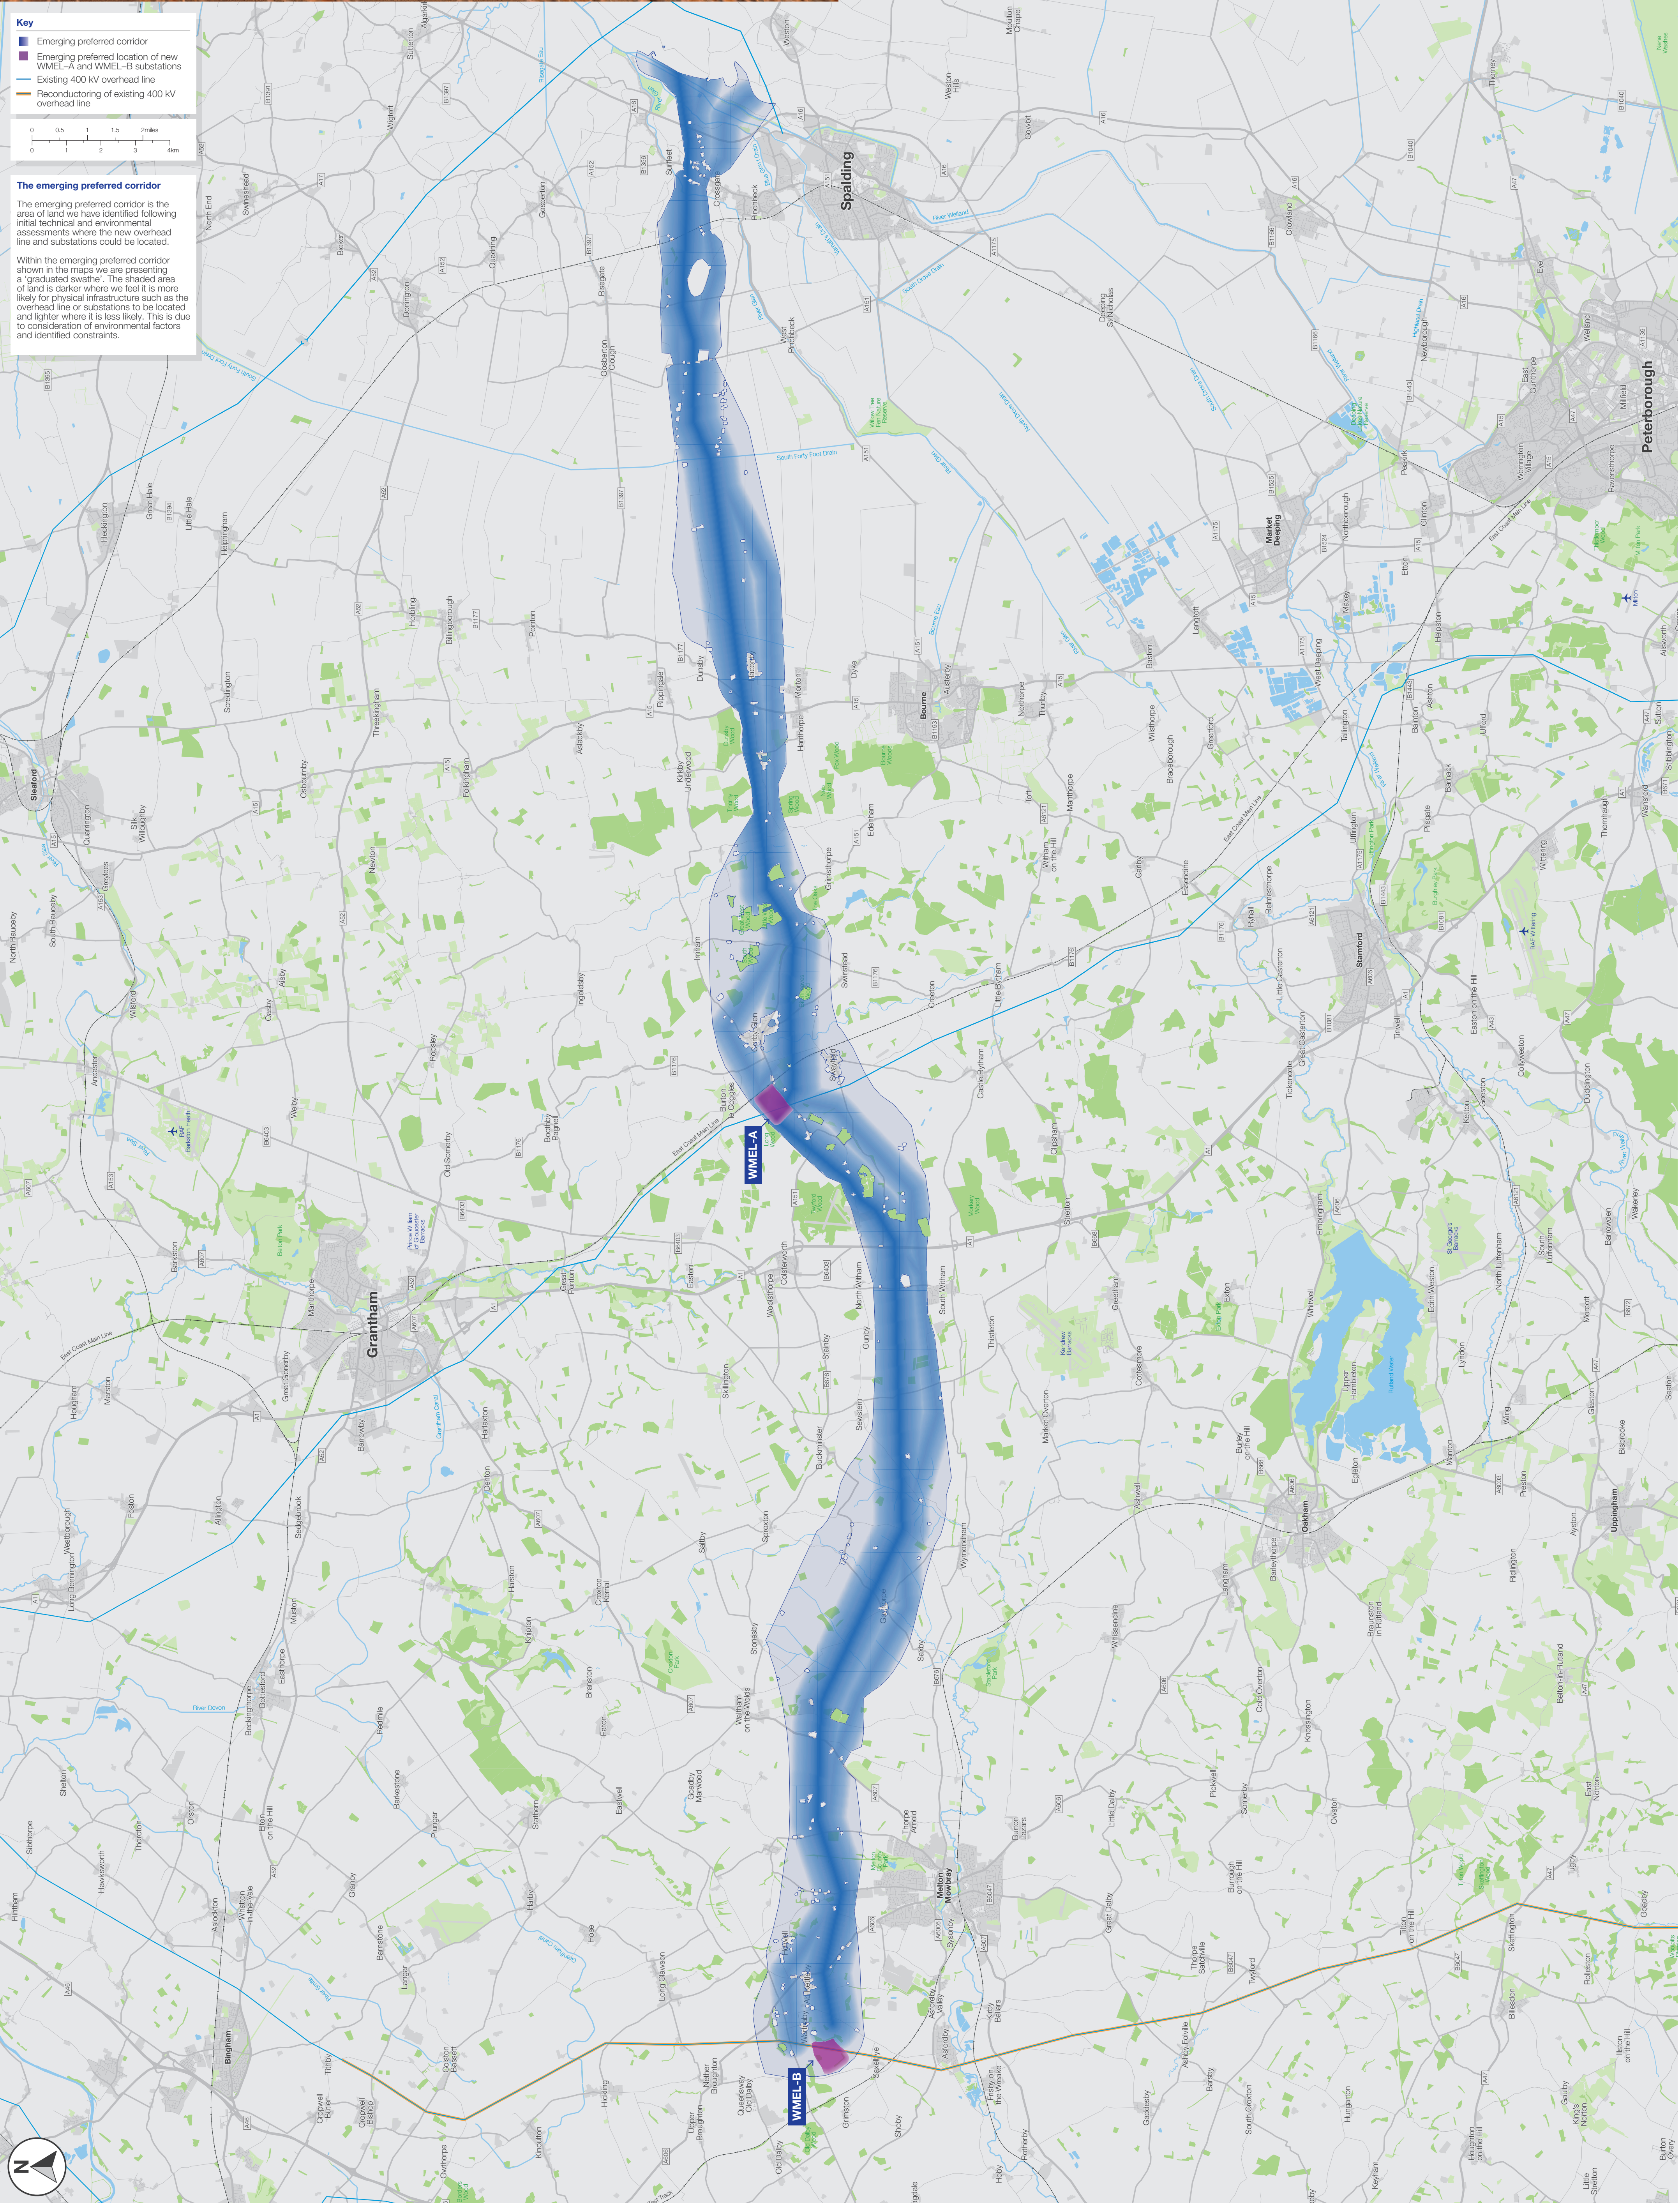

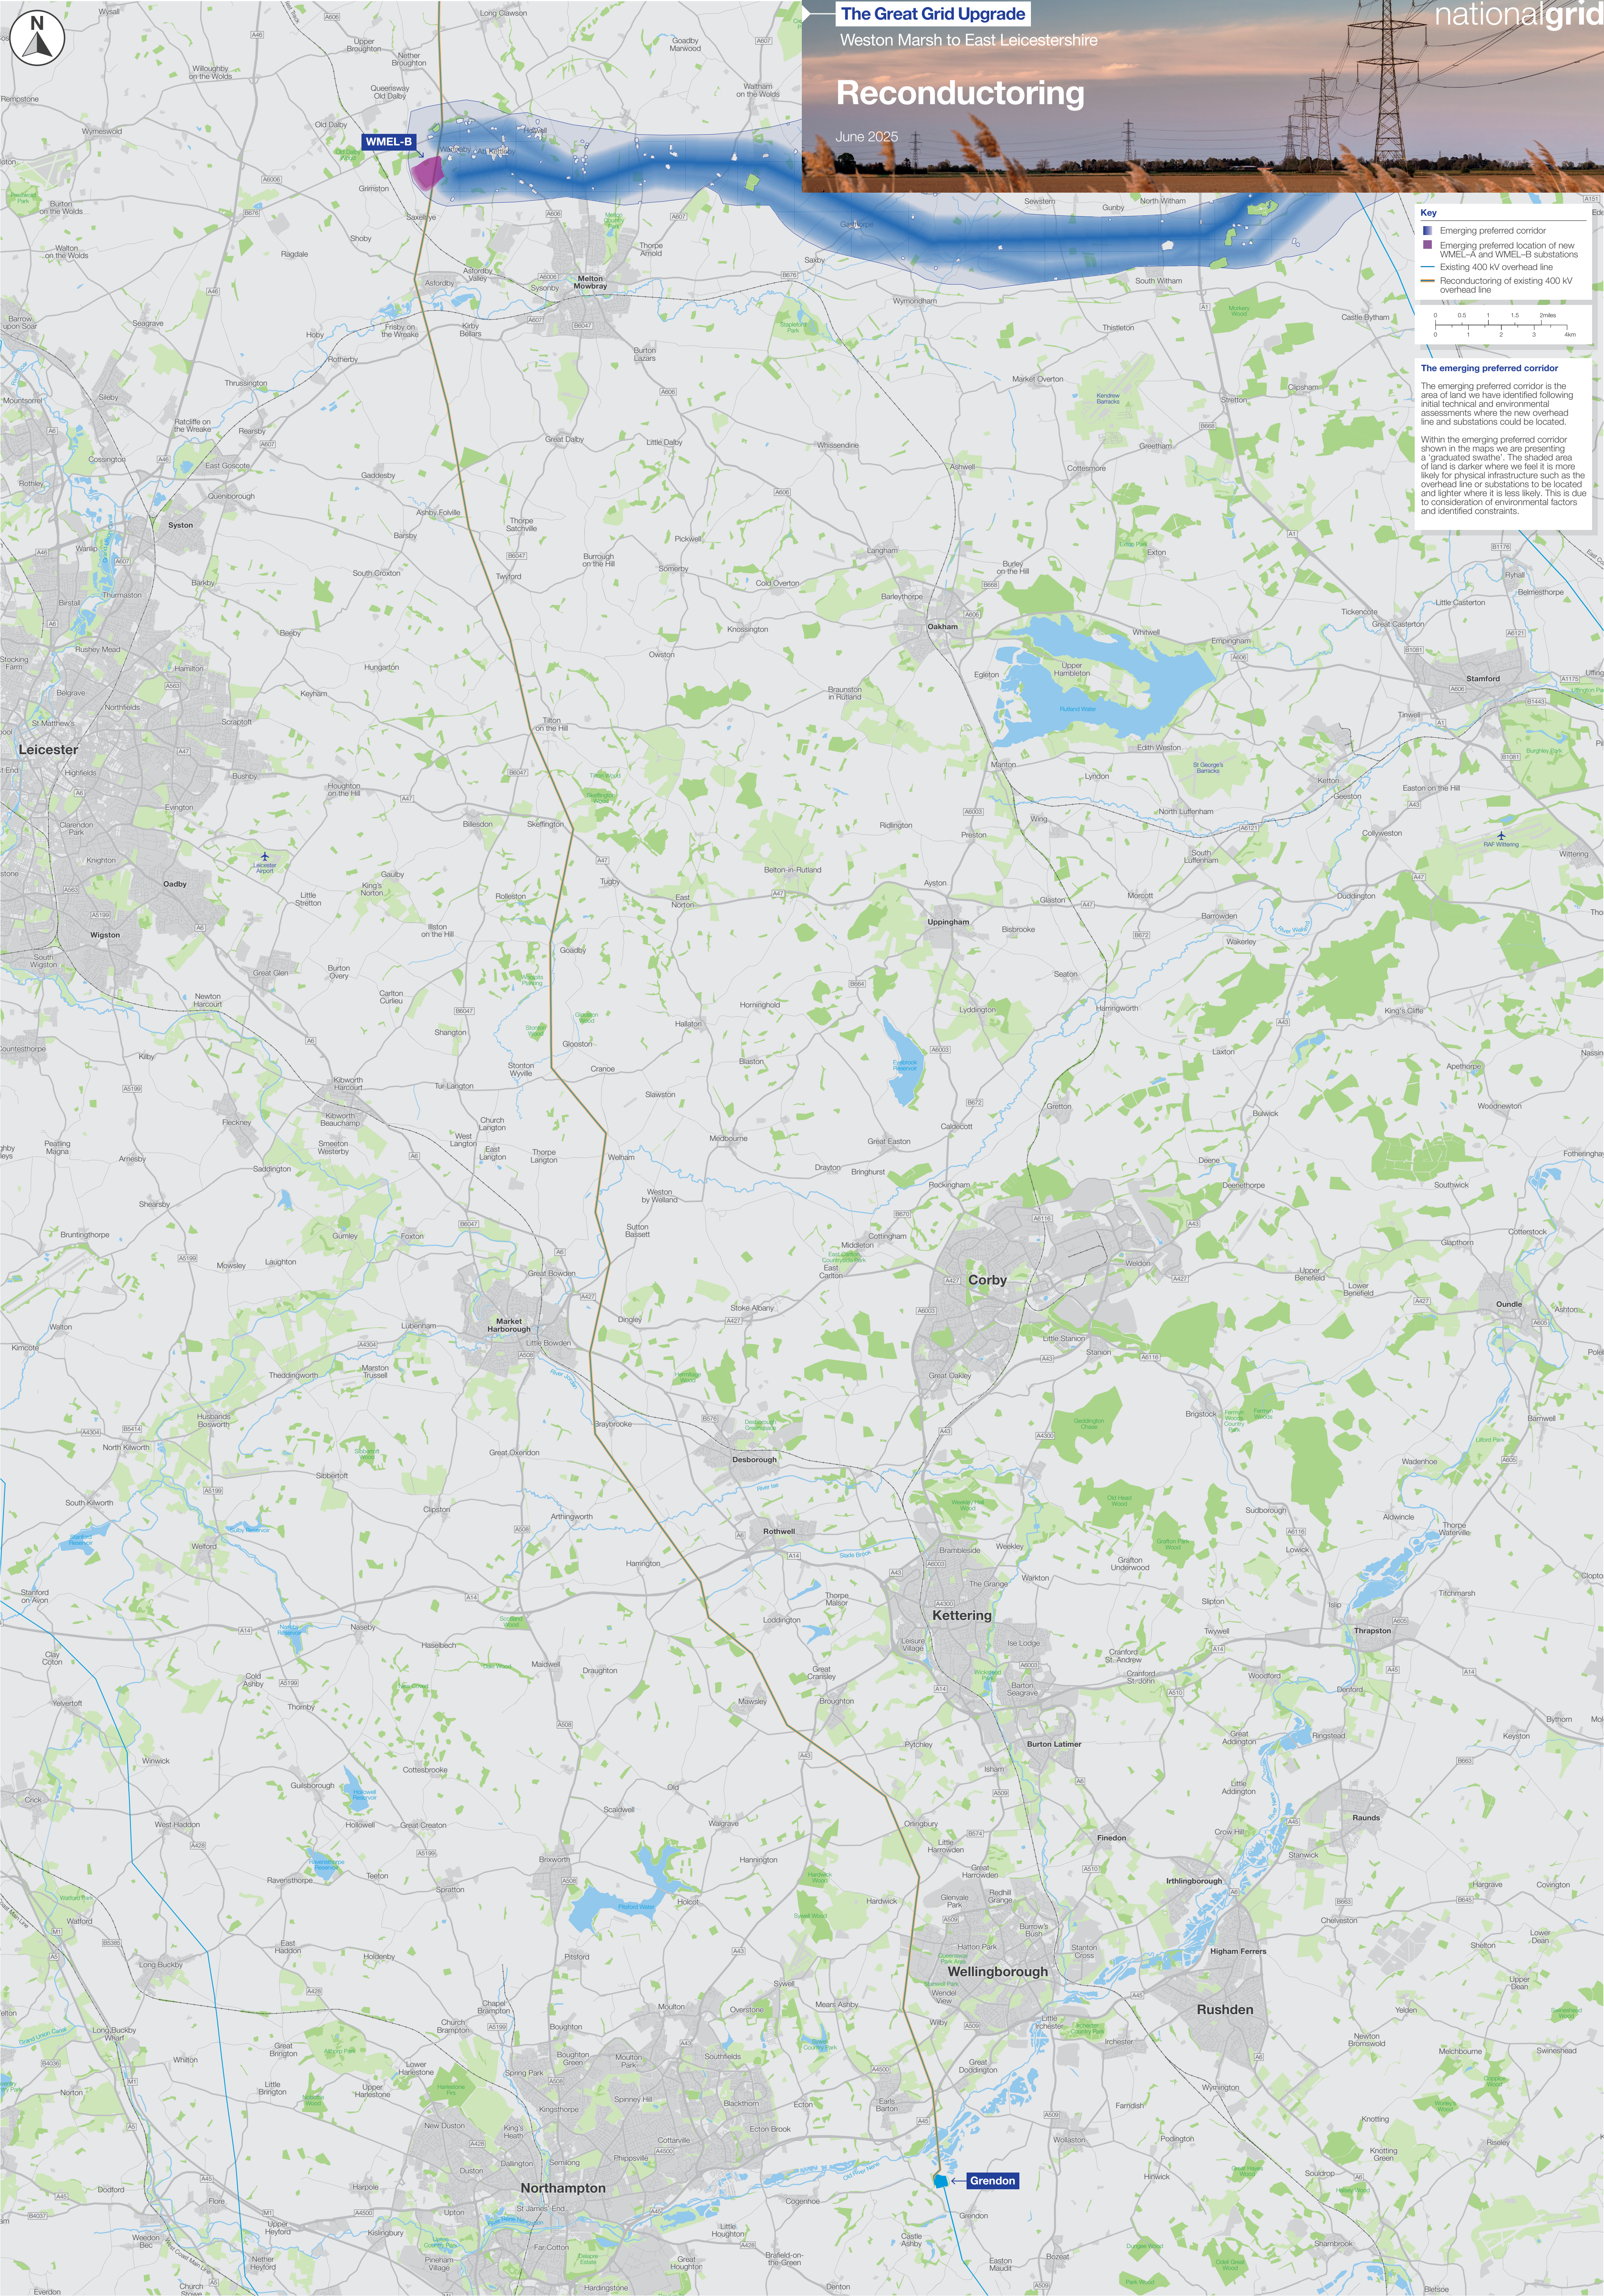

The Great Grid Upgrade

Weston Marsh to East Leicestershire

Reconductoring

June 2025

Key

- Emerging preferred corridor
- Emerging preferred location of new WMEL-A and WMEL-B substations
- Existing 400 kV overhead line
- Reconductoring of existing 400 kV overhead line

The emerging preferred corridor

The emerging preferred corridor is the area of land we have identified following initial technical and environmental assessments where the new overhead line and substations could be located.

Within the emerging preferred corridor shown in the maps we are presenting a 'graduated swathe'. The shaded area of land is darker where we feel it is more likely for physical infrastructure such as the overhead line or substations to be located and lighter where it is less likely. This is due to consideration of environmental factors and identified constraints.