

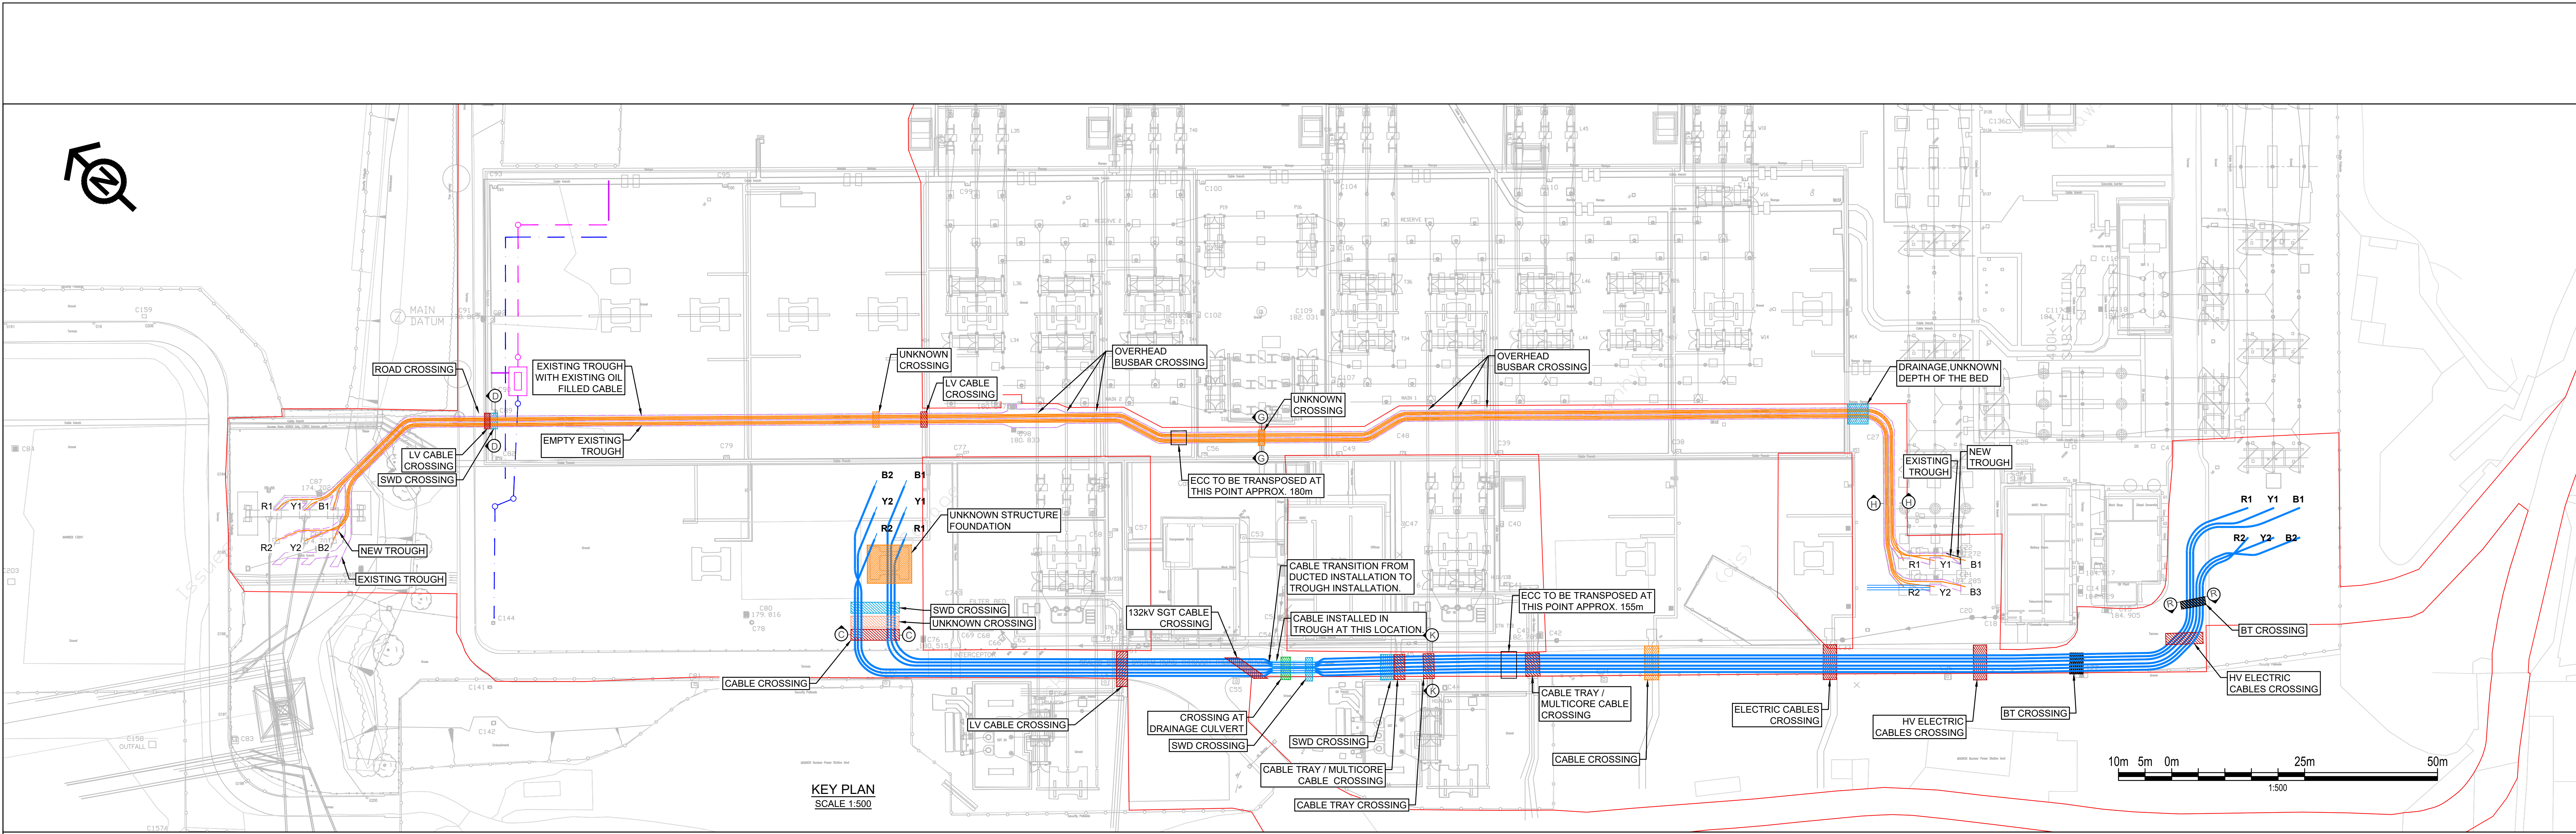
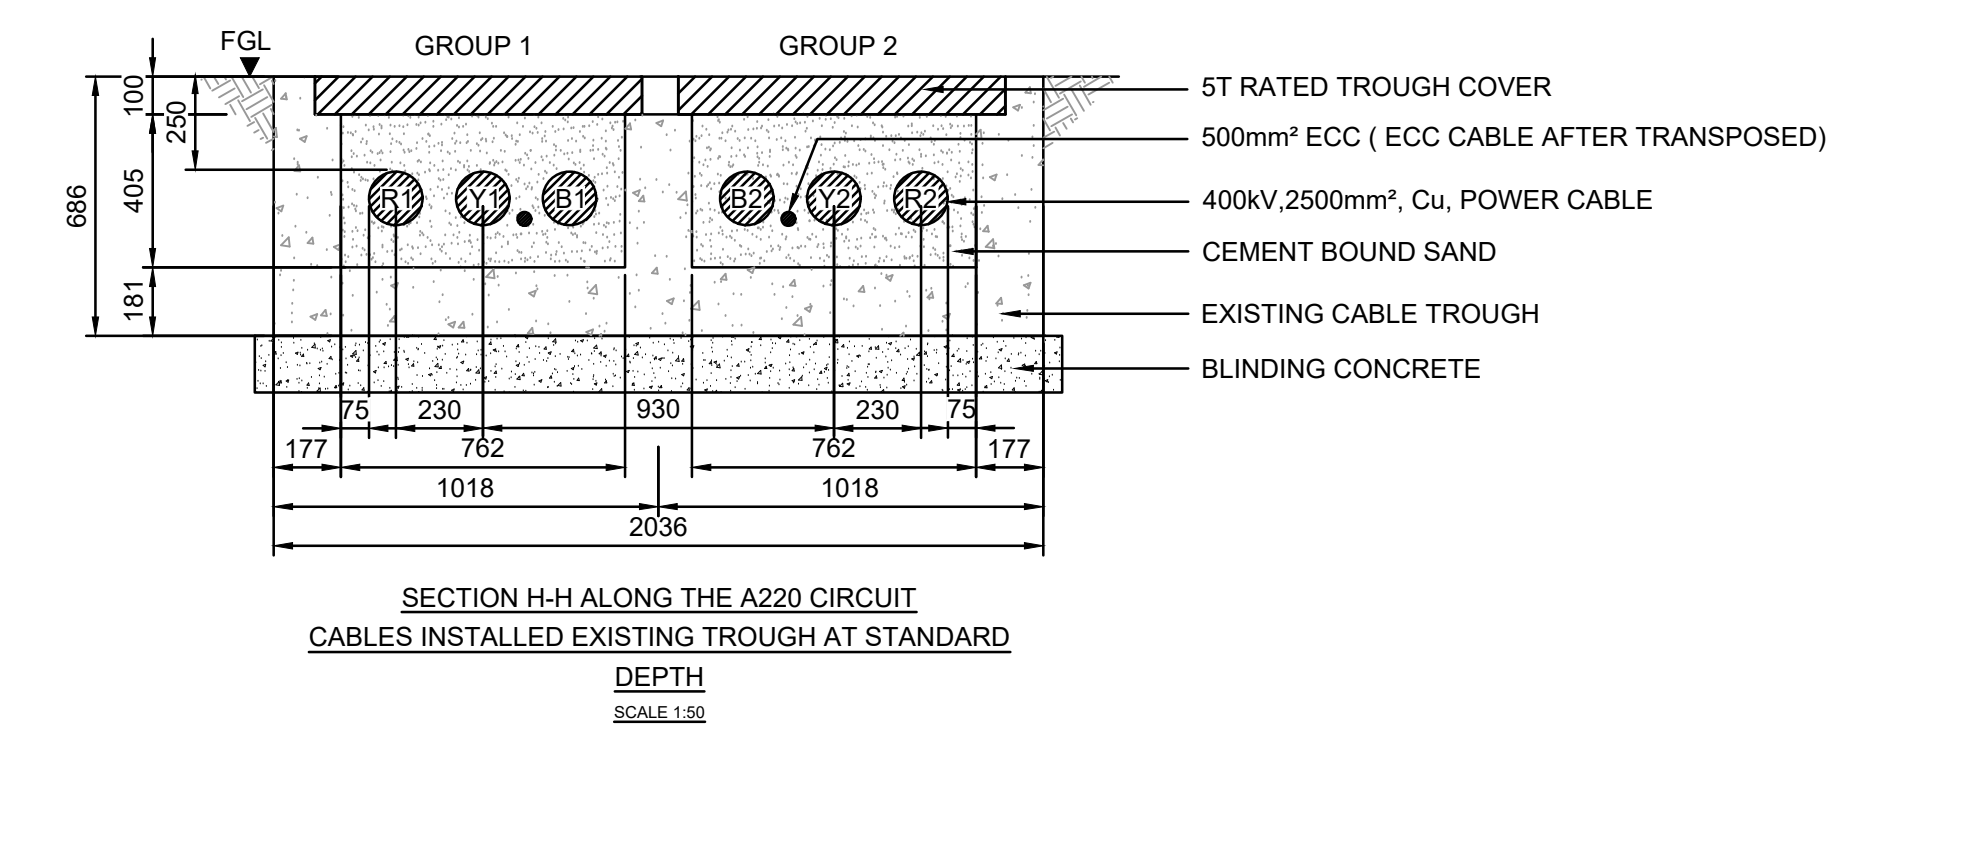
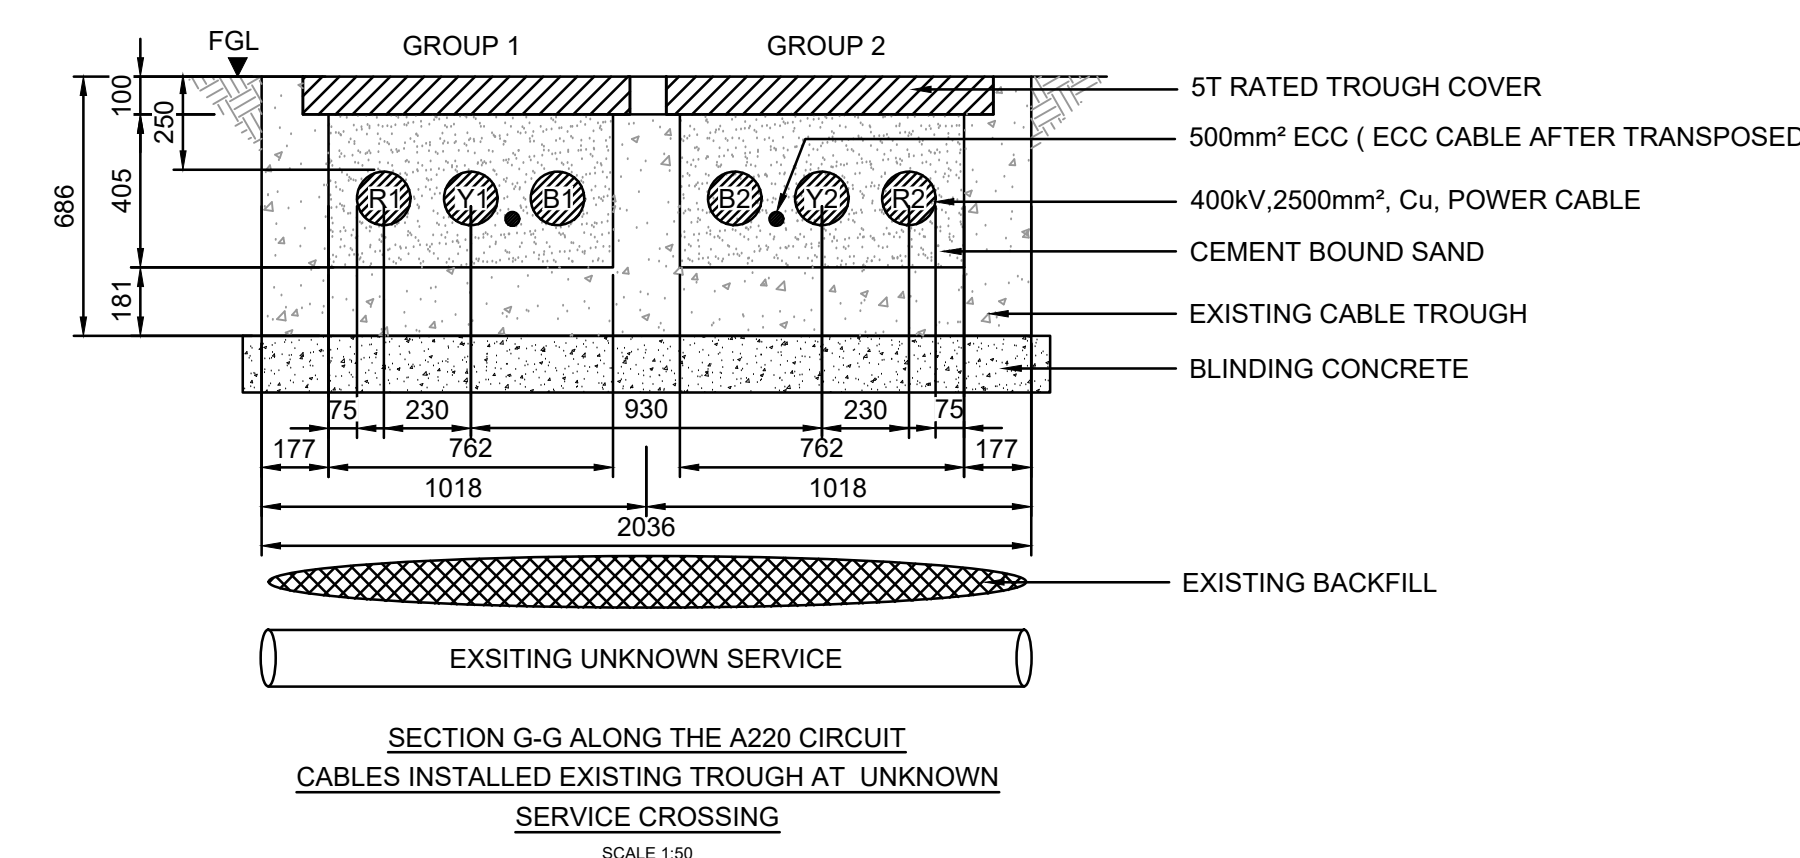
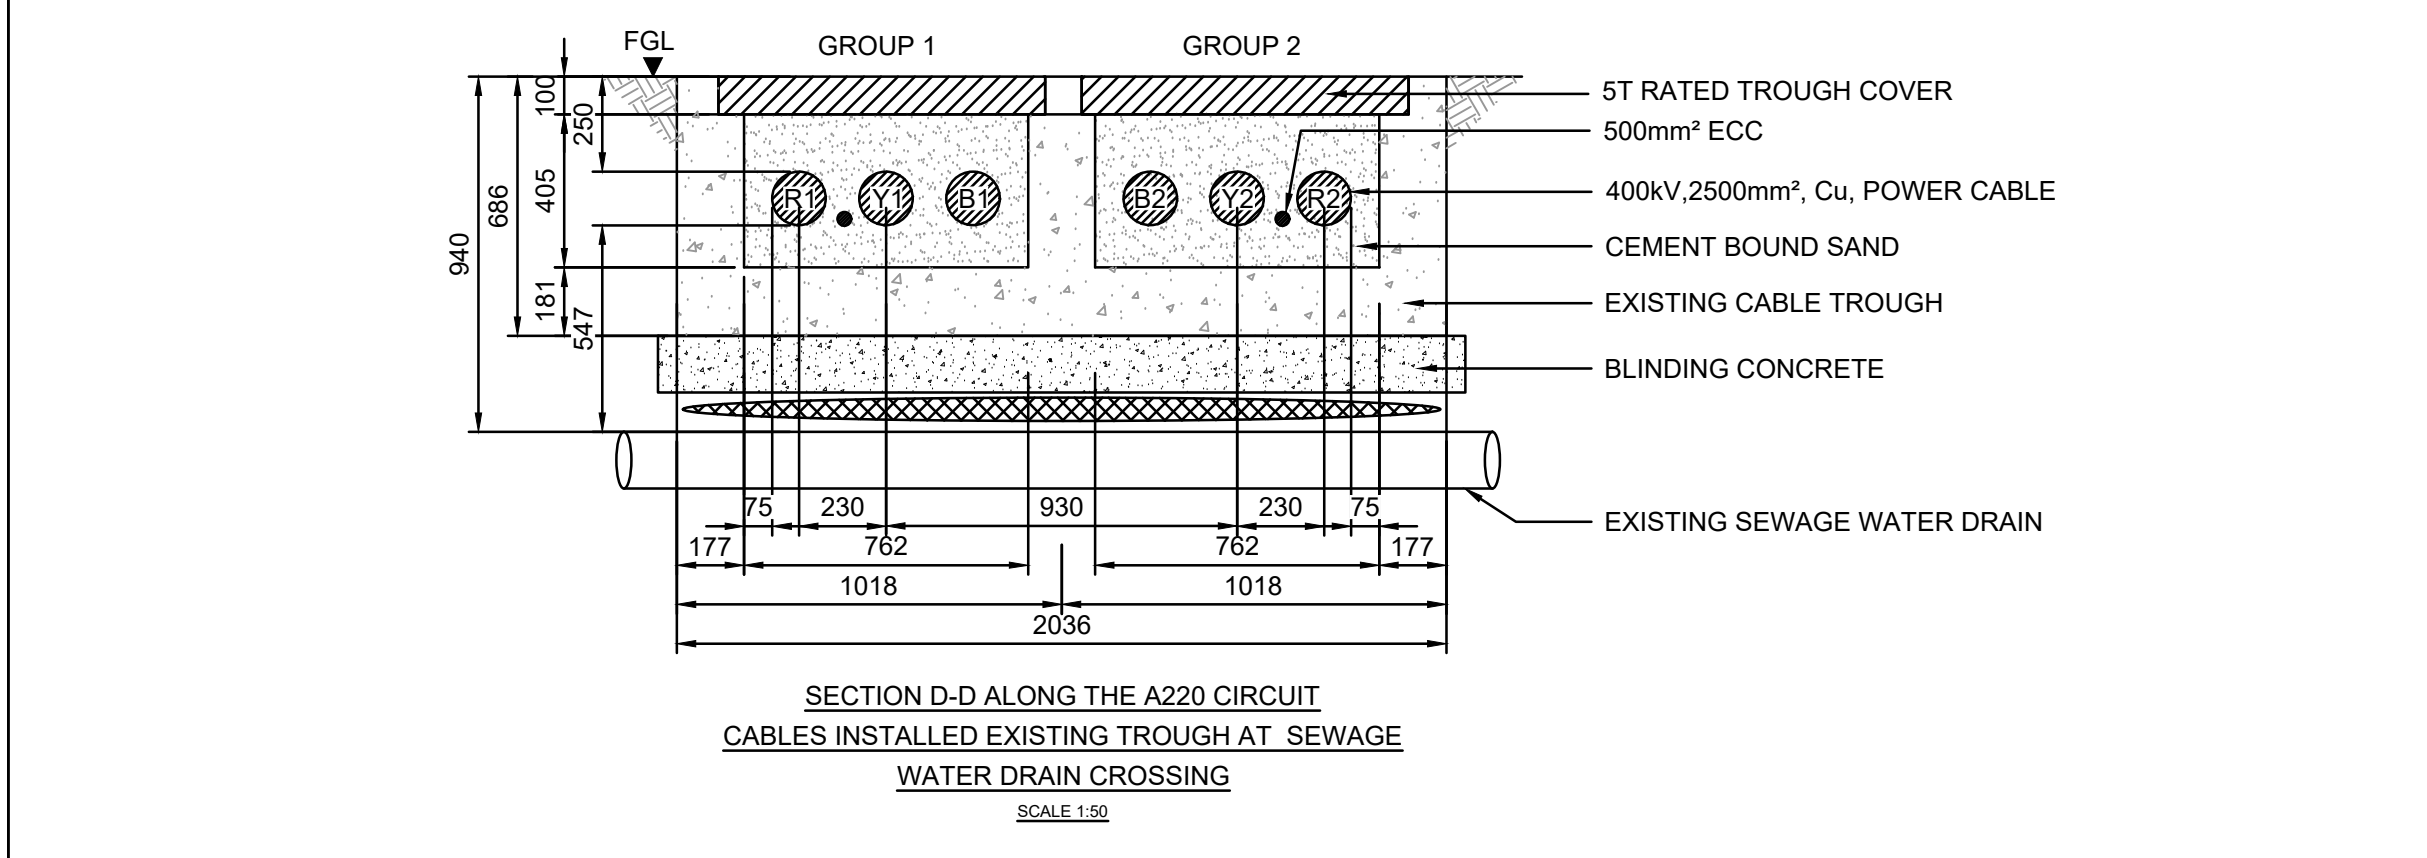
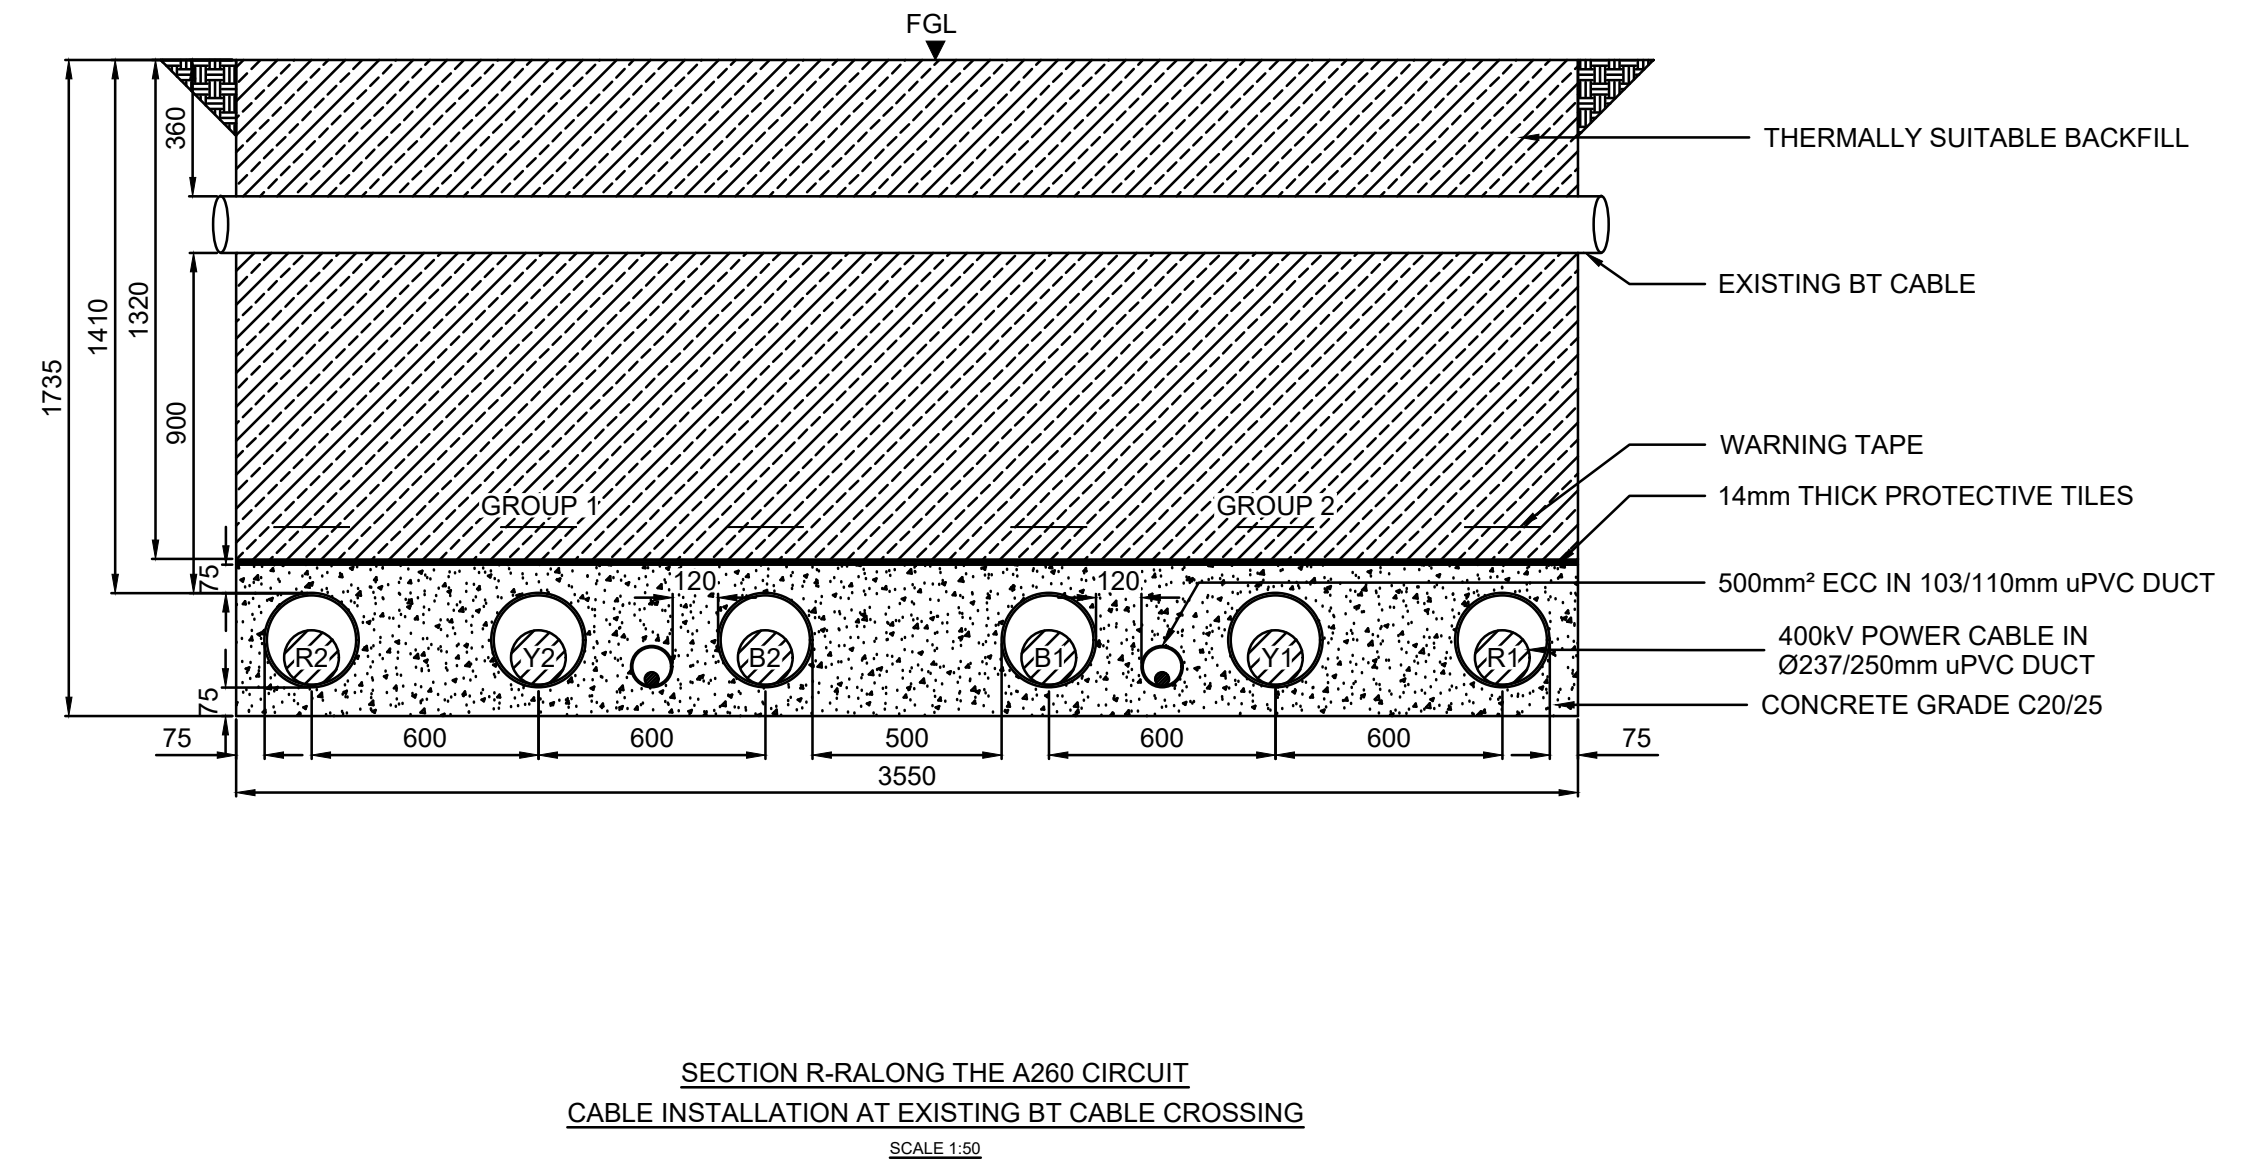


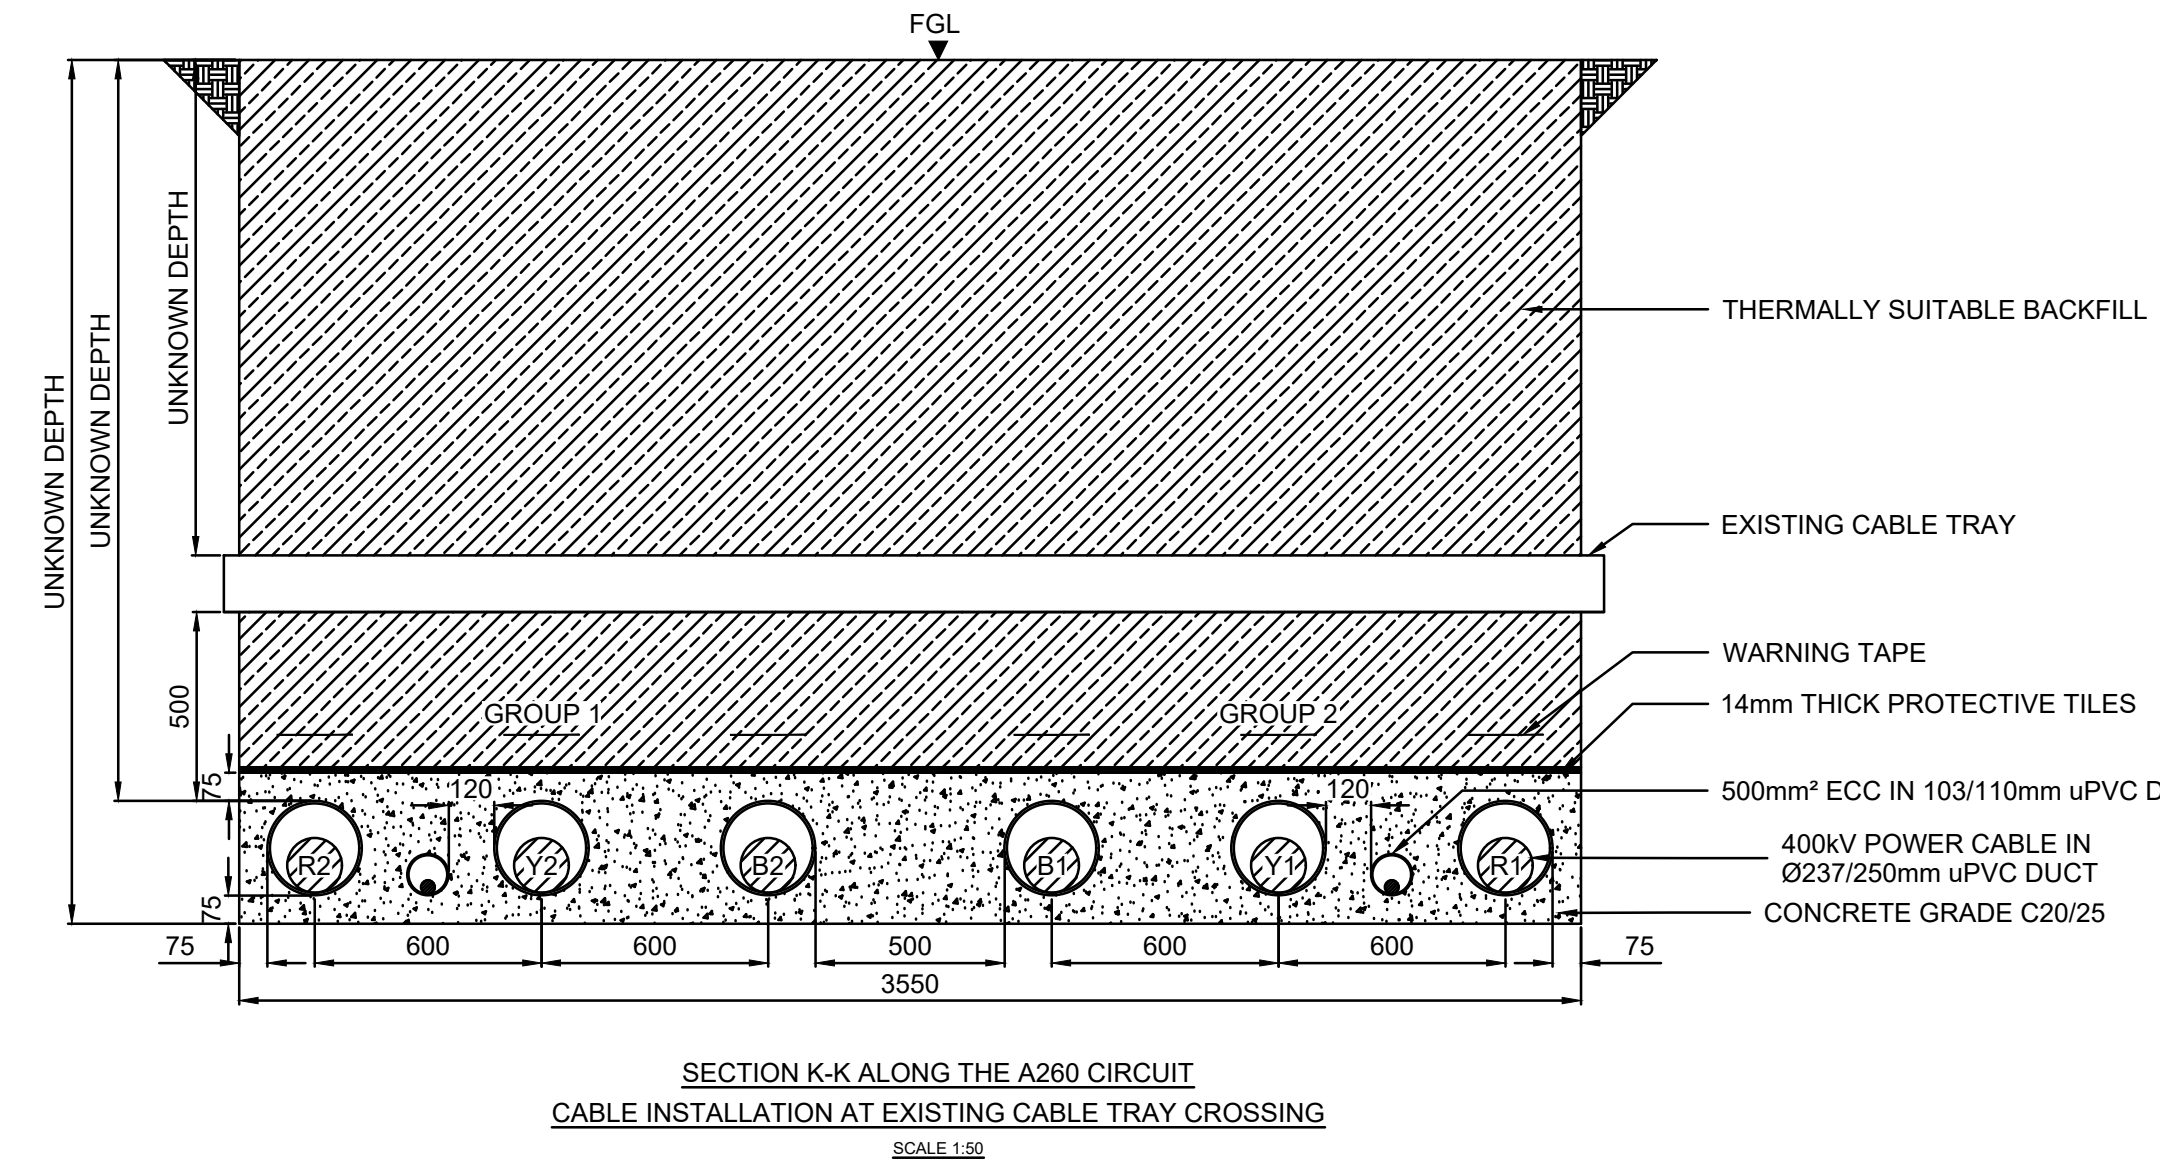


- Legend**
- APPLICATION SITE BOUNDARY
 - EXISTING TRAWSFYNDD SUBSTATION
 - EXISTING UNDERGROUND A220 CABLE TROUGH
 - PROPOSED UNDERGROUND A220 CABLE ROUTES
 - PROPOSED UNDERGROUND A260 CABLE ROUTES
 - PROPOSED OIL SUPPLY
 - PROPOSED WATER SUPPLY
 - PROPOSED VEHICLE BARRIER
 - PROPOSED ROAD RE-ALIGNMENT WORKS
 - PROPOSED PLANT FOUNDATIONS
 - EXISTING PENTR-TRAWSFYNDD 400kV CABLE CIRCUIT
 - PROPOSED ROAD CROSSING
 - PROPOSED SWD SEWER CROSSING
 - PROPOSED HV ELECTRIC CABLE CROSSING
 - PROPOSED UNKNOWN SERVICE CROSSING
 - PROPOSED BAND OF CABLE CROSSING
 - PROPOSED DRAINAGE CULVERT CROSSING

- GENERAL NOTES:**
- THE LOCATION OF THE NEW EQUIPMENTS SHOWN WITHIN THIS DRAWING WILL BE DETERMINED BASED ON SUFFICIENT CLEARANCE FROM THE OVERHEAD LINE (OHL) STRINGING OF THE EXISTING LINE BAYS. THIS CLEARANCE WILL BE REVIEWED CONSIDERING OUTAGES OF ADJACENT BAYS & MEWP ACCESS & EGRESS DURING THE SITE VISIT OR IN THE NEXT PROJECT STAGE.
 - ECC IS NOT SHOWN FOR CLARITY.

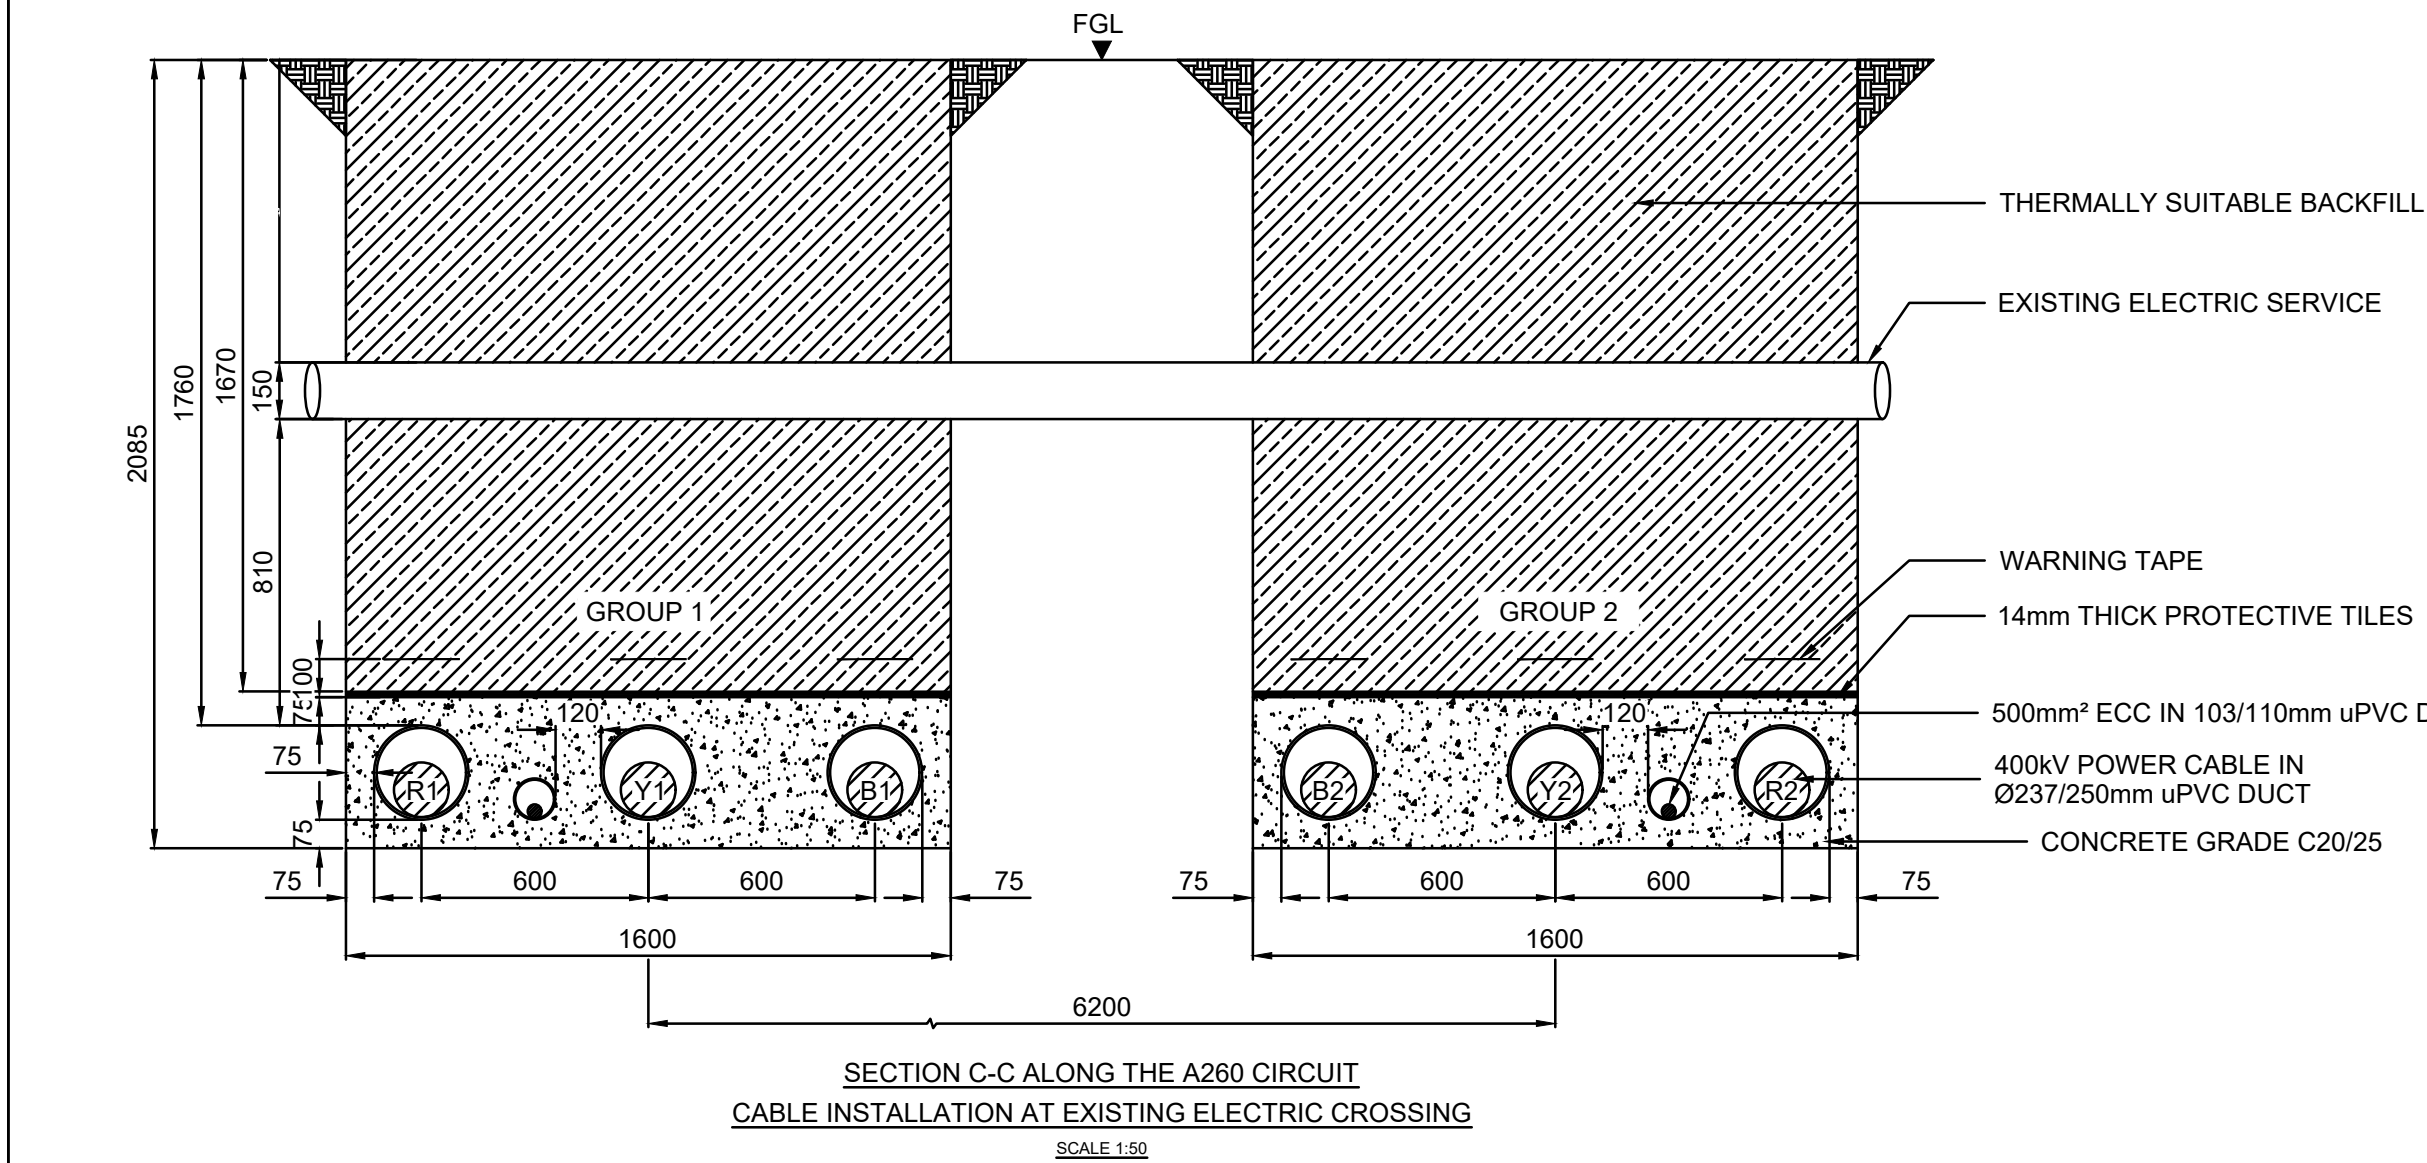

Notes

This drawing is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against

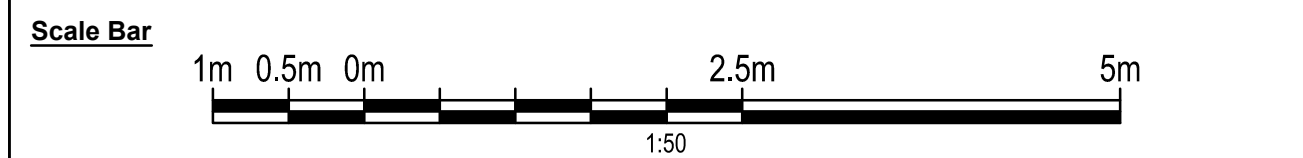

BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HER MAJESTY'S STATIONARY OFFICE CROWN. © COPYRIGHT AND DATABASE RIGHTS 2024 ORDNANCE SURVEY 0100031673.

P01	12/09/25	FIRST ISSUE	TM	MT	RW
Issue	Date	Remarks	Drawn	Checked	Approved

Title

TRAWSFYNDD
PROPOSED UNDERGROUND WORKS CROSS SECTIONS
(FOR TCPA)