




NATIONAL GRID  
 WESTON MARSH SUBSTATION A CONNECTION  
 SECTION 37 2WS APPLICATION OVERHEAD LINE WORKS PLAN  
 SHEET 1 OF 2

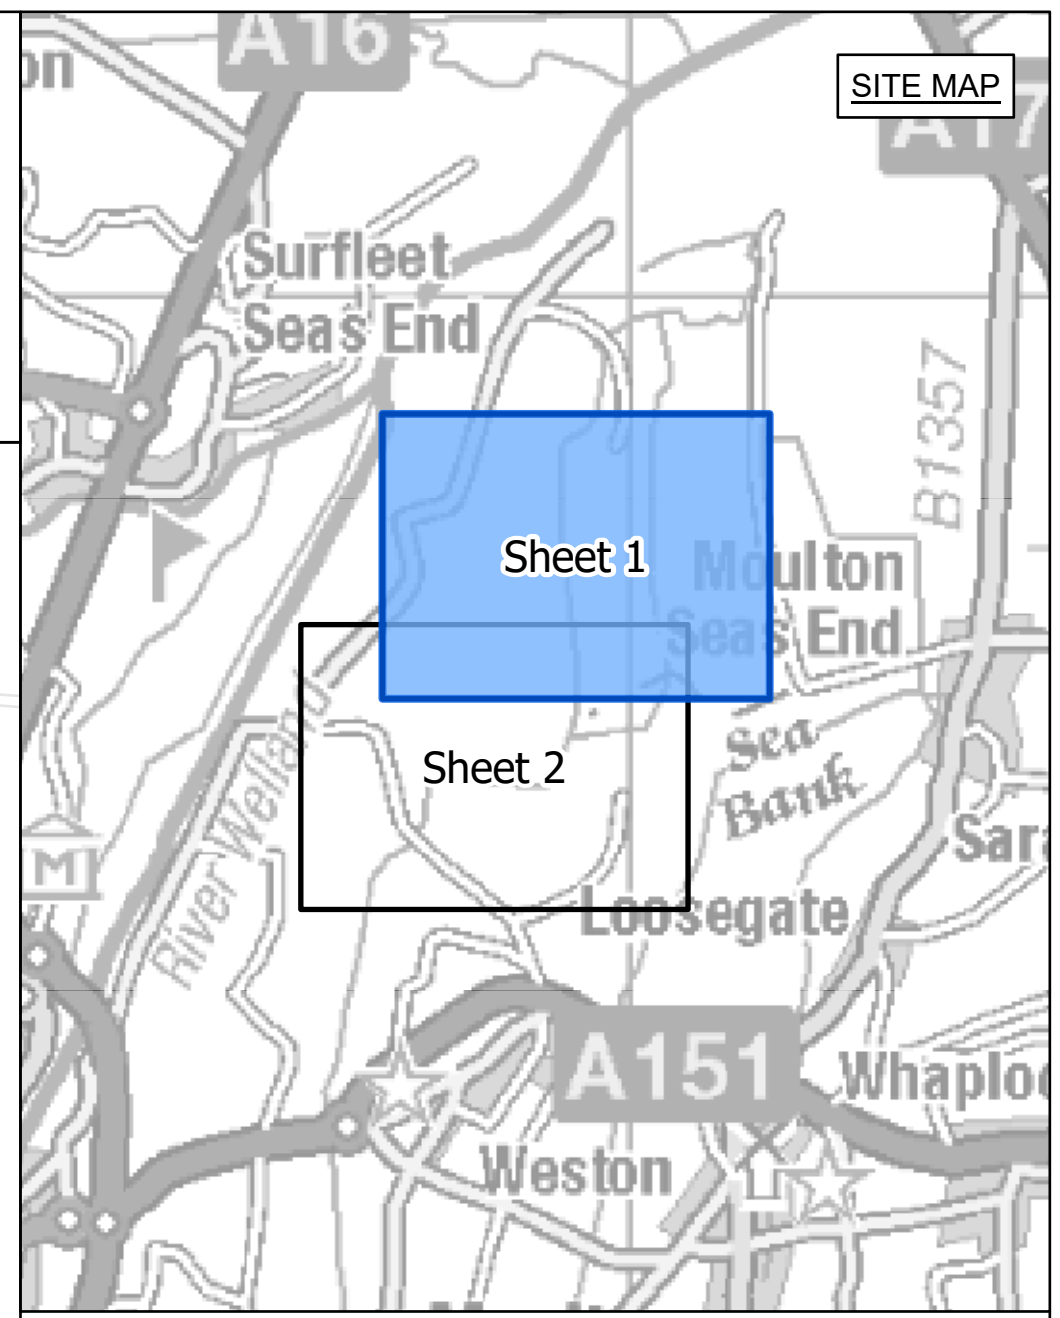

- LEGEND**
- SHEET INDEX CUTLINES
  - ▭ S37 2WS OVERHEAD LINE WORKS SITE BOUNDARY
  - ⊗ INDICATIVE NEW LATTICE PYLON
  - ⊗ EXISTING LATTICE PYLON - TO BE MODIFIED
  - ⊗ EXISTING LATTICE PYLON - TO BE DISMANTLED
  - INDICATIVE NEW OVERHEAD LINE
  - EXISTING OVERHEAD LINE - TO BE DISMANTLED
  - ▭ INDICATIVE S37 2WS ACCESS ROUTE - STONE
  - EXISTING LATTICE PYLON
  - ⊗ INDICATIVE TCPA GANTRY
  - INDICATIVE TCPA SUBSTATION BOUNDARY
  - ▭ INDICATIVE TCPA ACCESS ROUTE - STONE

**SHES BOX**  
 (containing Safety, Health and Environmental Information)

In addition to the hazards and risks normally associated with constructing, maintaining and demolishing the structures on this drawing, the following significant risk information should be taken into account when planning and carrying out construction, maintenance and demolition work.

|  |
|--|
| <b>CONSTRUCTION</b>                      |
| • Site Compounds close to Overhead Lines |
| <b>OPERATION</b>                         |
| <b>MAINTENANCE</b>                       |
| <b>DECOMMISSIONING</b>                   |

**Notes**

Indicative position of infrastructure within the RLB may move within the Limits of Deviation (LoD) as shown on Illustrative Overhead Line LoD drawing ref. GWNC-LST-4ZM-ZZZZZ-DRW-EN-000022.

Items to be dismantled will only be removed once both 2WS & 4ZM lines are operational.

This drawing is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.

Coordinate System: British National Grid  
 Sheet X Centroid Coordinate: 525644 Sheet Y Centroid Coordinate: 328274

0 100 200 300 Meters

BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. © CROWN COPYRIGHT AND DATABASE RIGHTS 2026 AC000807948. © BLUESKY INTERNATIONAL LTD. NATIONAL GRID ELECTRICITY - 100024241. NATIONAL GRID GAS - 100024886.

|       |            |                |       |         |          |
|-------|------------|----------------|-------|---------|----------|
| Issue | Date       | Remarks        | Drawn | Checked | Approved |
| A     | 12/08/2026 | FOR SUBMISSION | MG    | JP      | XX       |


**Title**

NATIONAL GRID  
 WESTON MARSH  
 SUBSTATION A CONNECTION  
 SECTION 37 2WS APPLICATION  
 OVERHEAD LINE WORKS PLAN  
 SHEET 1 OF 2



National Grid Drawing Reference  
 GWNC-LST-2WS-ZZZZZ-PLN-EN-000008



|         |            |              |       |
|---------|------------|--------------|-------|
| Scale   | Sheet Size | Sheet        | Issue |
| 1:2,500 | A0         | SHEET 1 OF 2 | A     |

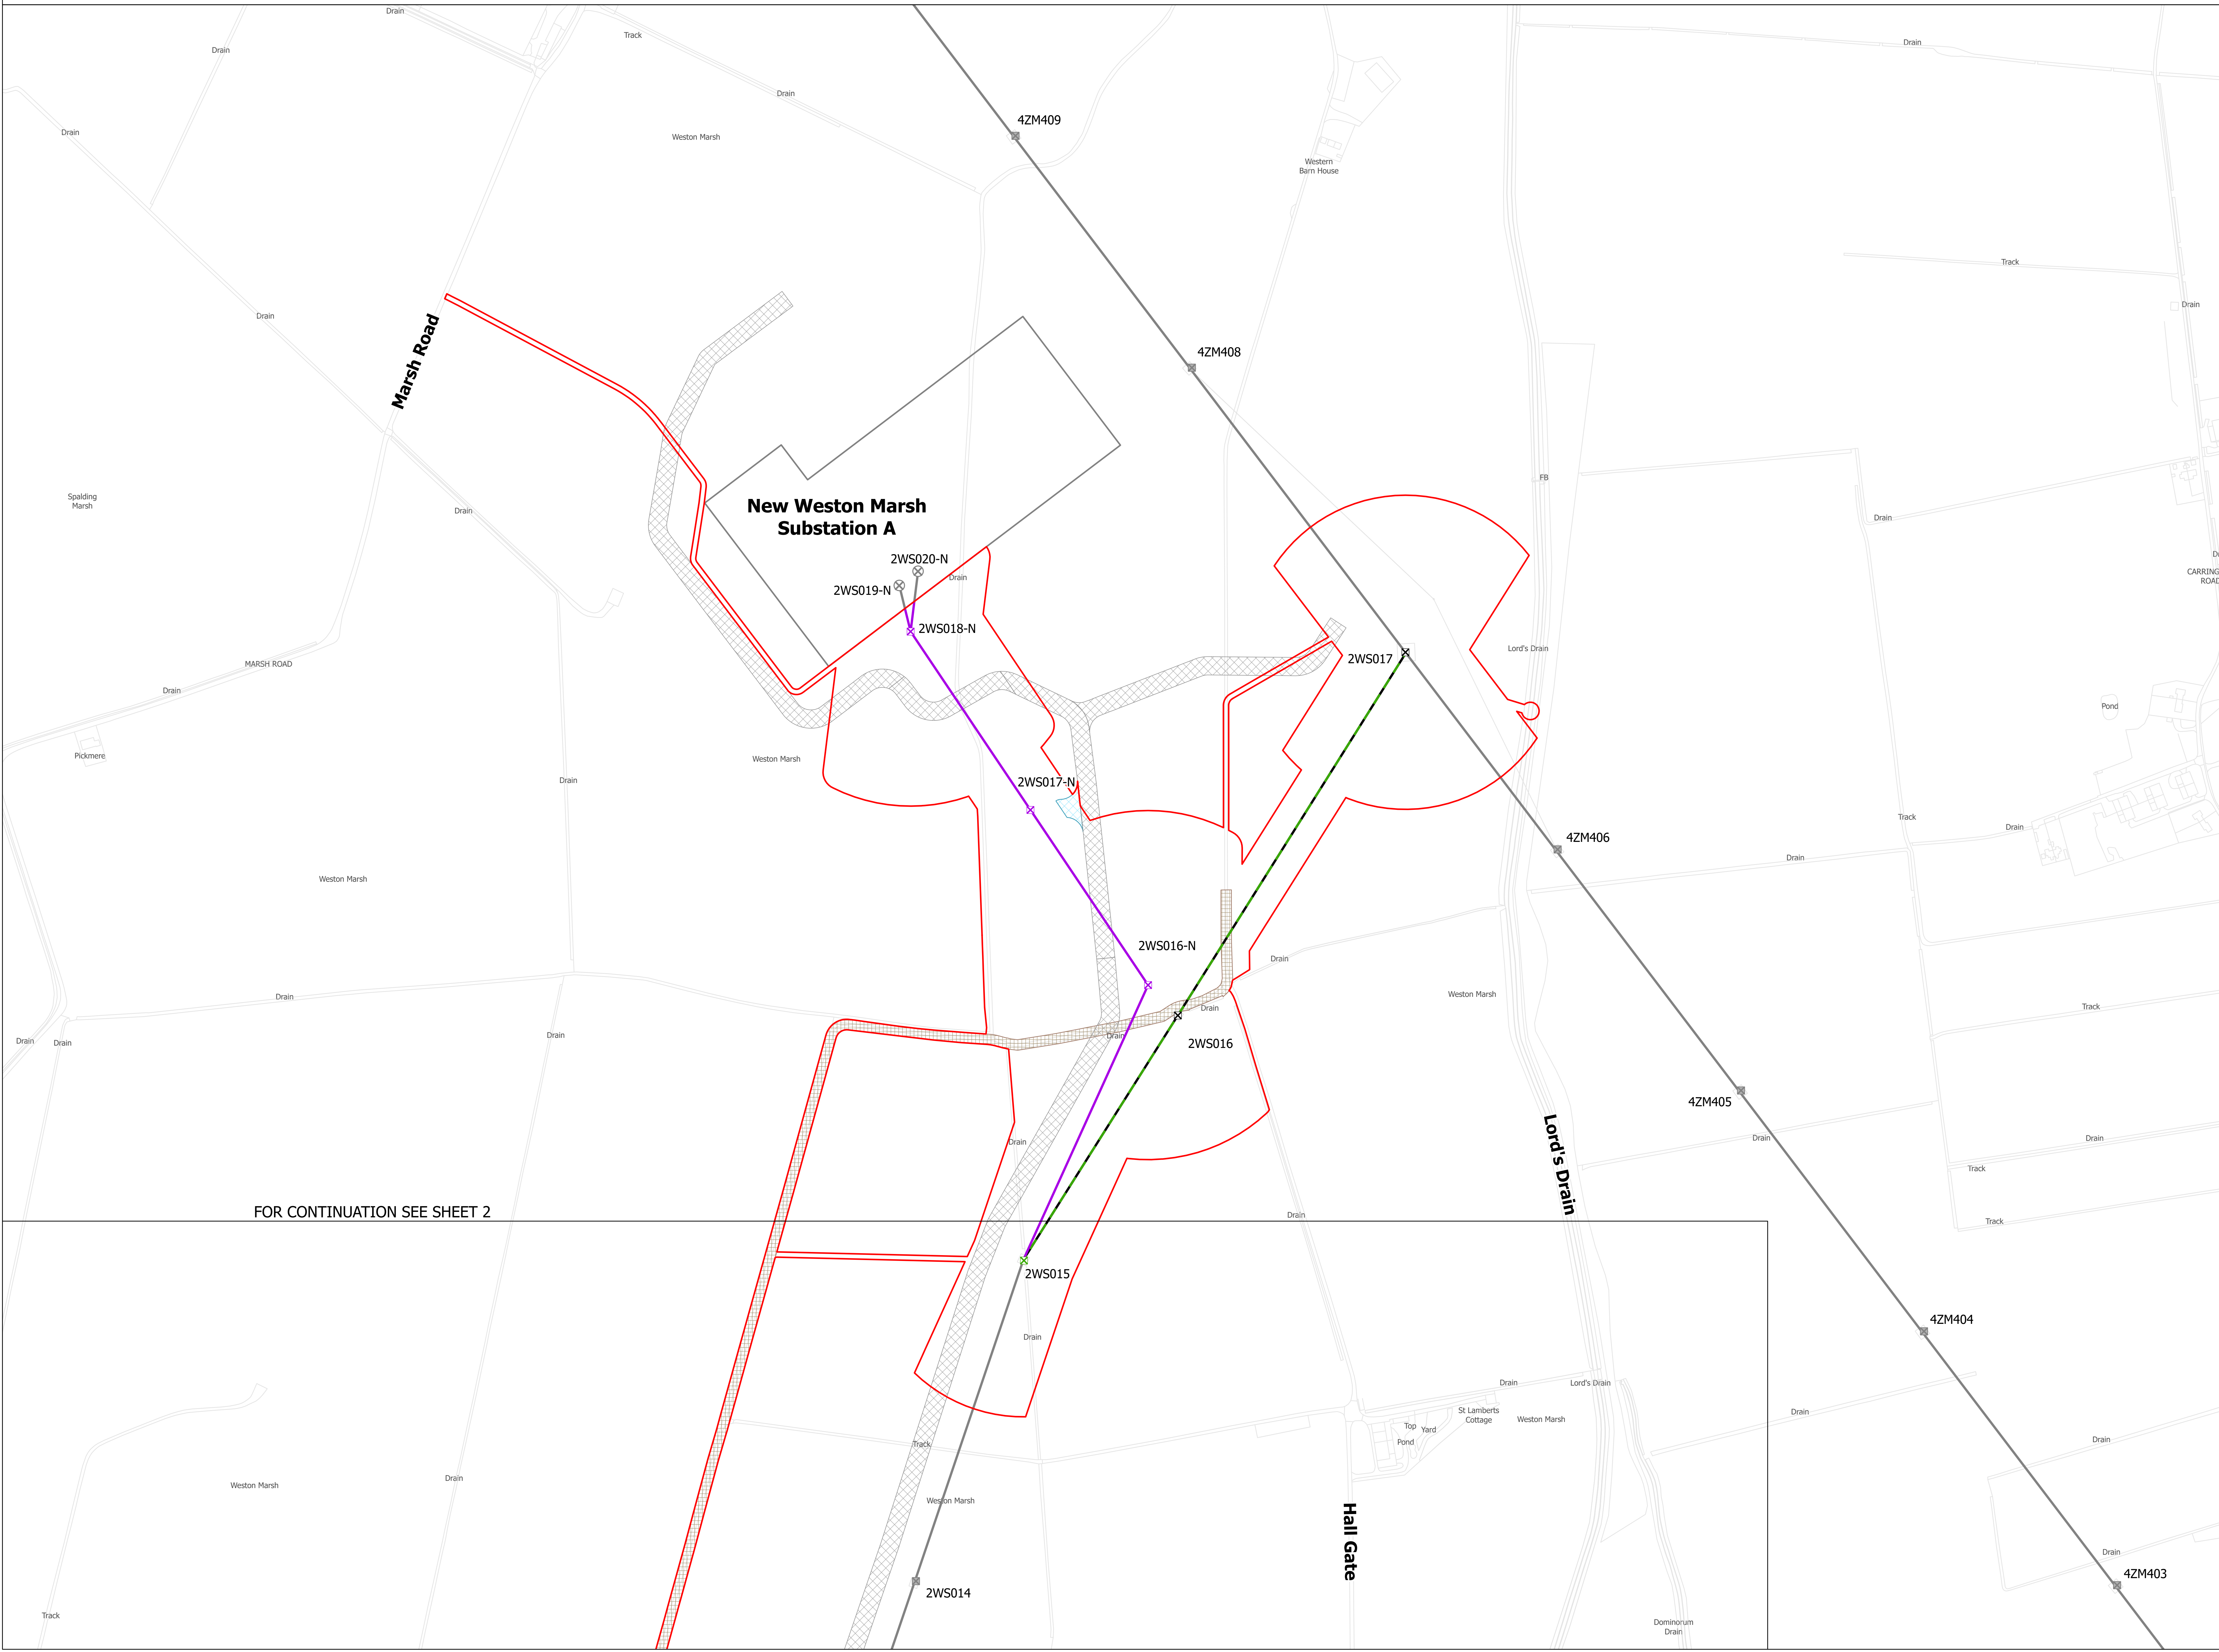

FOR CONTINUATION SEE SHEET 2



NATIONAL GRID  
 WESTON MARSH SUBSTATION A CONNECTION  
 SECTION 37 2WS APPLICATION OVERHEAD LINE WORKS PLAN  
 SHEET 2 OF 2

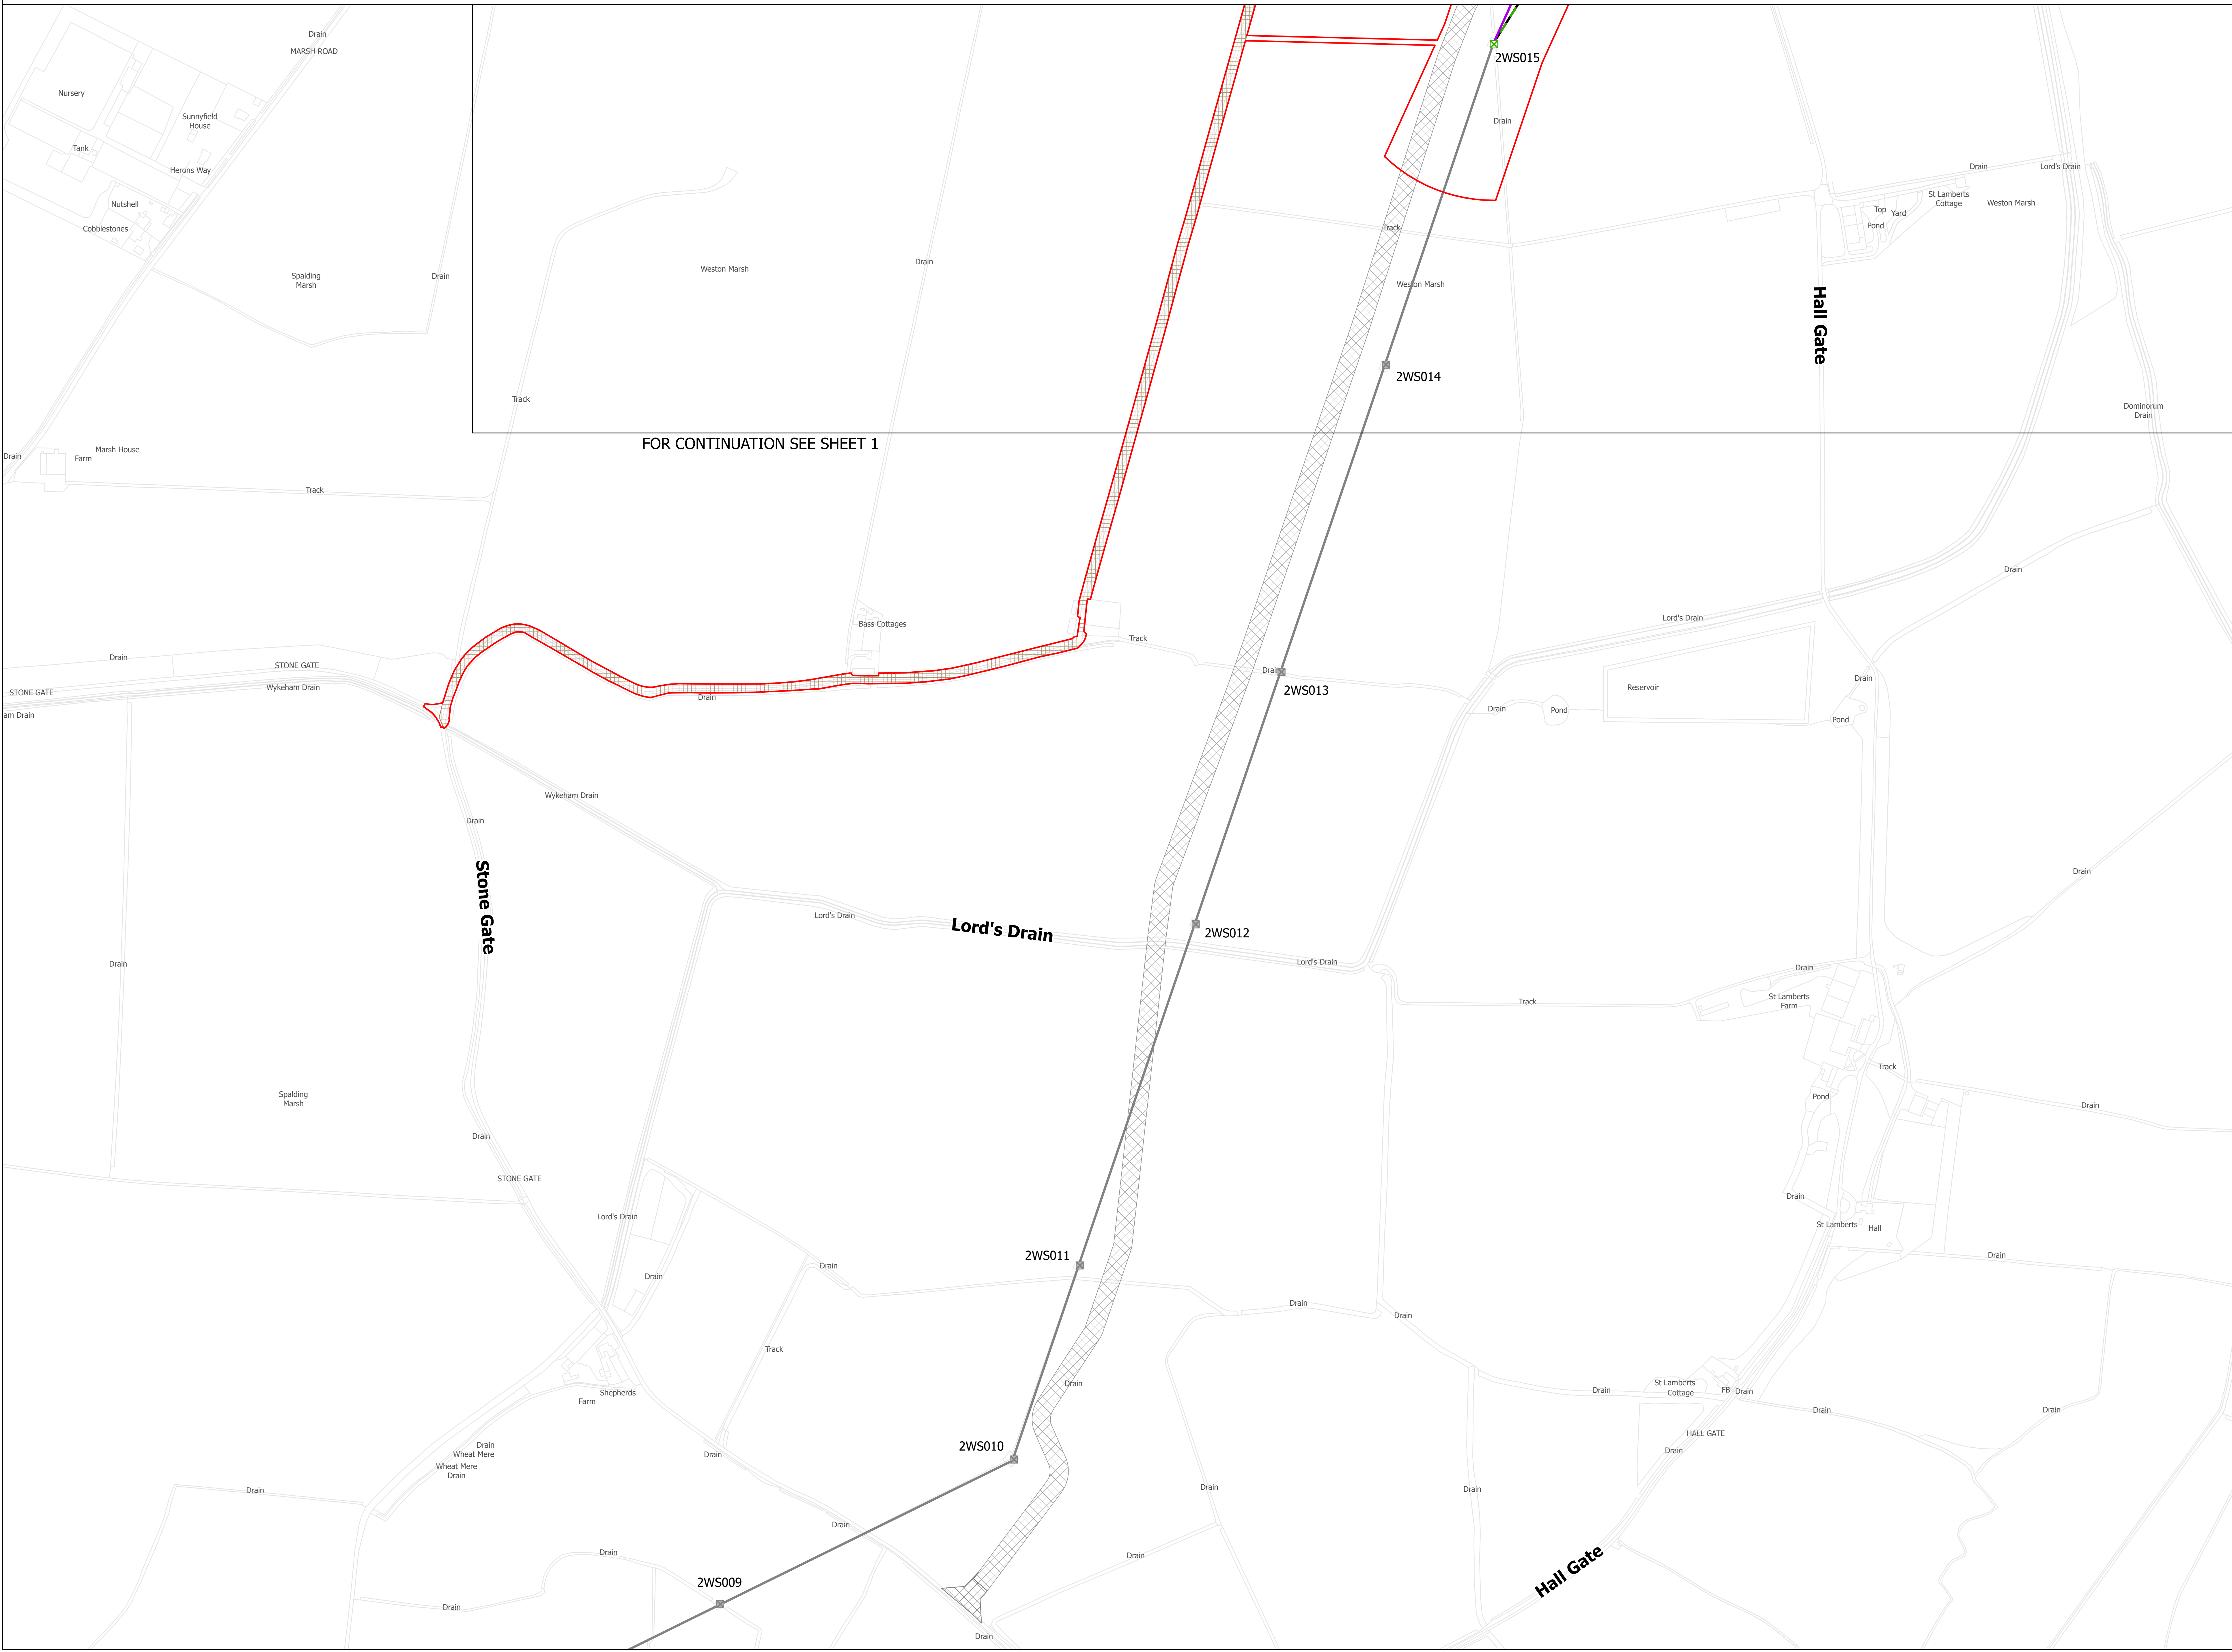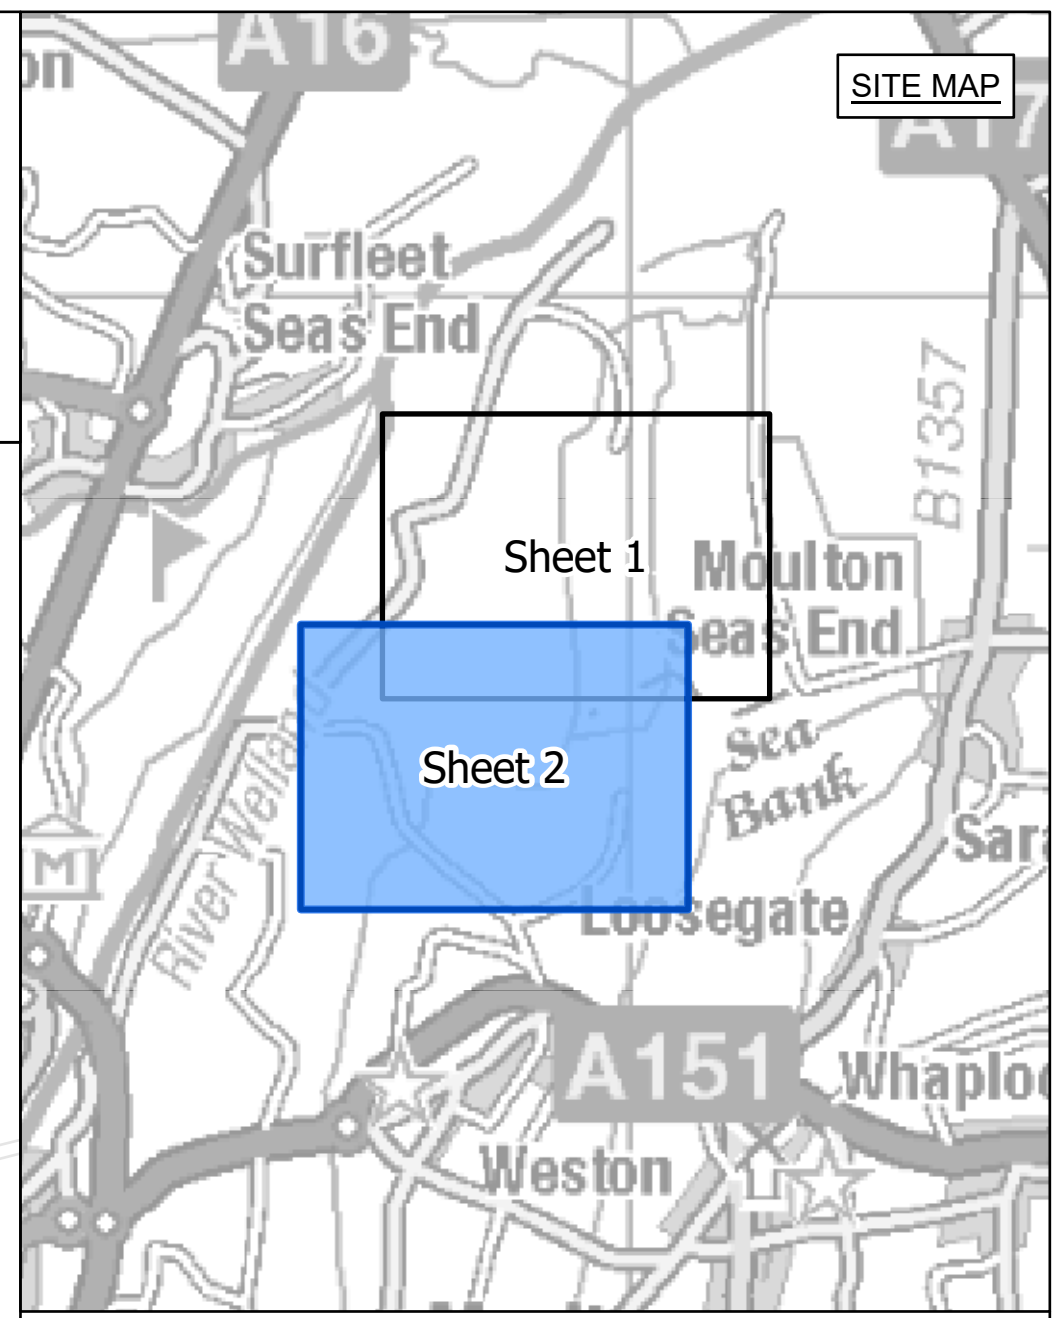

**LEGEND**

- SHEET INDEX OUTLINES
- ▭ S37 2WS OVERHEAD LINE WORKS SITE BOUNDARY
- ⊗ INDICATIVE NEW LATTICE PYLON
- ⊗ EXISTING LATTICE PYLON - TO BE MODIFIED
- ⊗ EXISTING LATTICE PYLON - TO BE DISMANTLED
- INDICATIVE NEW OVERHEAD LINE
- EXISTING OVERHEAD LINE - TO BE DISMANTLED
- ▭ INDICATIVE S37 2WS ACCESS ROUTE - STONE
- ▭ EXISTING LATTICE PYLON
- OVERHEAD LINE
- ⊗ INDICATIVE TCPA GANTRY
- ▭ INDICATIVE TCPA SUBSTATION BOUNDARY
- ▭ INDICATIVE TCPA ACCESS ROUTE - STONE

**SHES BOX**  
 (containing Safety, Health and Environmental Information)

In addition to the hazards and risks normally associated with constructing, maintaining and demolishing the structures on this drawing, the following significant risk information should be taken into account when planning and carrying out construction, maintenance and demolition work.

**CONSTRUCTION**

- Site Compounds close to Overhead Lines

**OPERATION**

**MAINTENANCE**

**DECOMMISSIONING**

**Notes**

Indicative position of infrastructure within the RLB may move within the Limits of Deviation (LoD) as shown on Illustrative Overhead Line LoD drawing ref. GWNC-LST-42M-ZZZZZZ-DRW-EN-000022.

Items to be dismantled will only be removed once both 2WS & 42M lines are operational.

This drawing is scaled at paper size A0, therefore any prints taken at smaller sizes will affect accuracy of the measurement units and should not be scaled against.

Coordinate System: British National Grid  
 Sheet X Centroid Coordinate: 529105 Sheet Y Centroid Coordinate: 326860

BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY BY PERMISSION OF ORDNANCE SURVEY OF THE CONTROLLER OF HIS MAJESTY'S STATIONERY OFFICE. © CROWN COPYRIGHT AND DATABASE RIGHTS 2026 AC000807948. © BLUESKY INTERNATIONAL LTD. NATIONAL GRID ELECTRICITY - 100024241. NATIONAL GRID GAS - 100024866.

| Issue | Date       | Remarks        | Drawn | Checked | Approved |
|-------|------------|----------------|-------|---------|----------|
| A     | 12/08/2026 | FOR SUBMISSION | MG    | JP      | XX       |

Title

NATIONAL GRID  
 WESTON MARSH  
 SUBSTATION A CONNECTION  
 SECTION 37 2WS APPLICATION  
 OVERHEAD LINE WORKS PLAN  
 SHEET 2 OF 2



National Grid Drawing Reference  
 GWNC-LST-2WS-ZZZZZZ-PLN-EN-000008

| Scale   | Sheet Size | Sheet        | Issue |
|---------|------------|--------------|-------|
| 1:2,500 | A0         | SHEET 2 OF 2 | A     |