
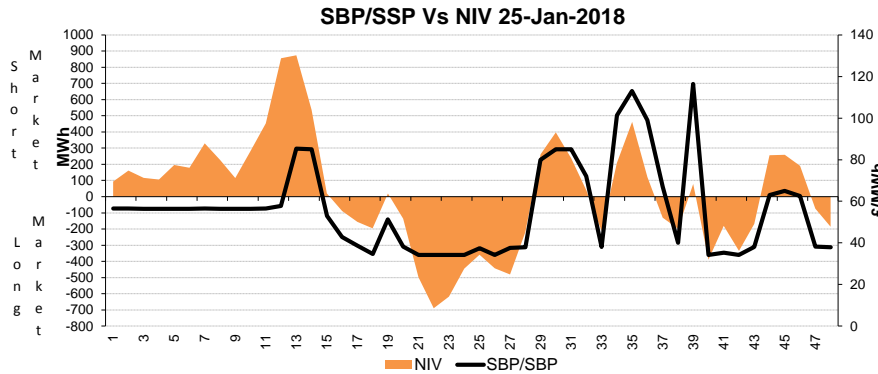
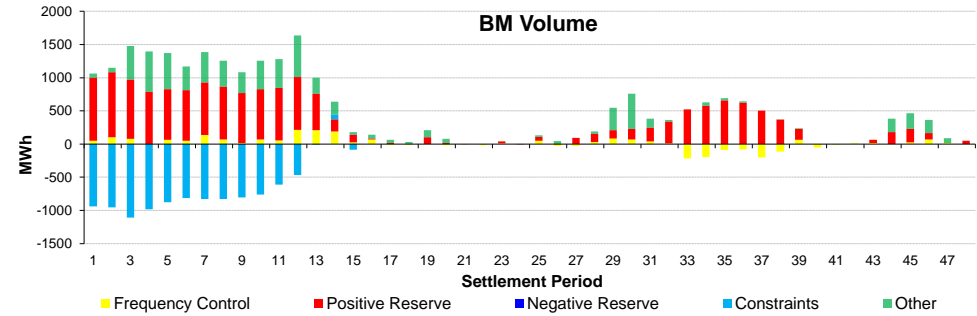
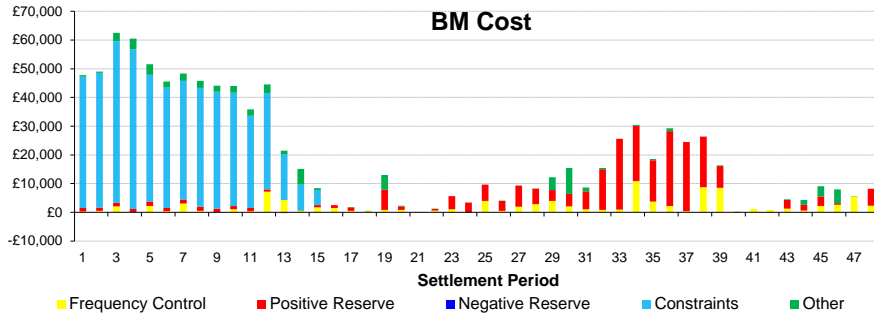
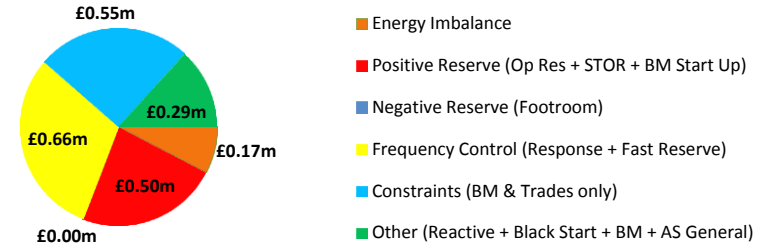


Daily Balancing Costs

BSUoS Charge Estimate: £1.52/MWh
Total Outturn: £2.17m

BM Cost (Indicative)
AS Cost (Estimate)



Commentary

Around 500MW of STOR were run during the morning peak and around 360MW over the darkness peak to account for underforecasted demand. Some trades were undertaken in the afternoon for upward margin. Overnight a mix of BM actions and trades were used to solve network powerflow restrictions between Scotland and England and to regulate the voltage levels in Wales area. RoCoF was regulated with trades on interconnectors and with some BM actions until the morning peak.