
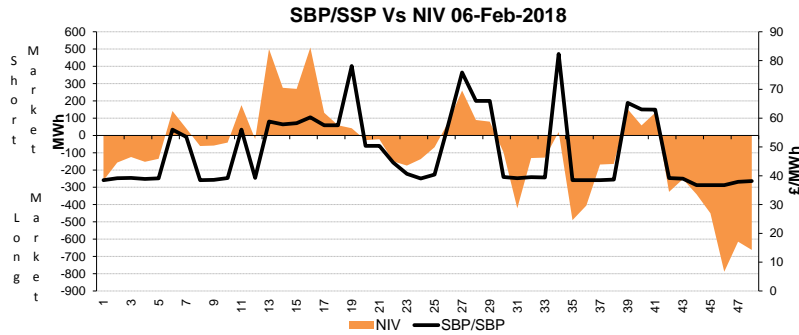
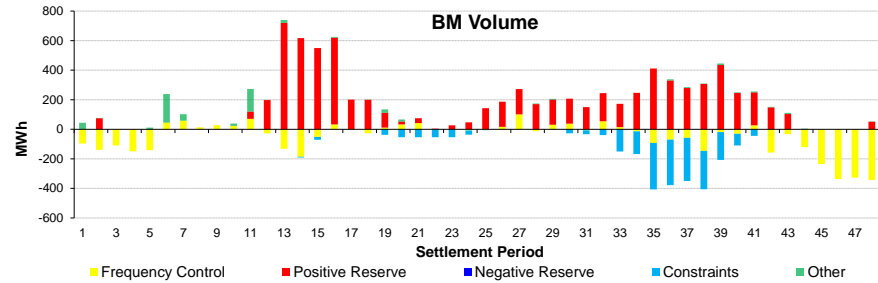
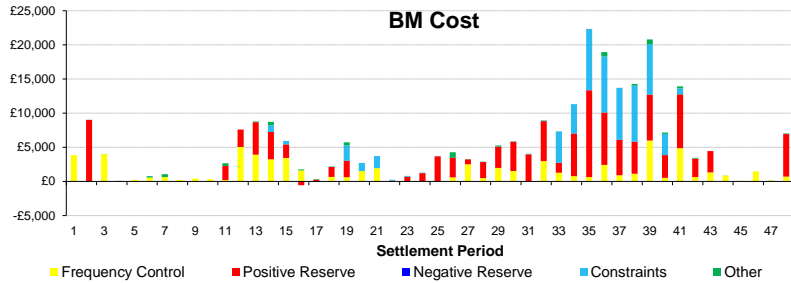
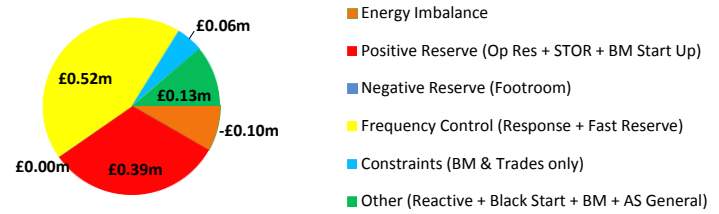


Daily Balancing Costs

Date:

06/02/2018

BSUoS Charge Estimate: £0.80/MWh
Total Outturn: £1.00m

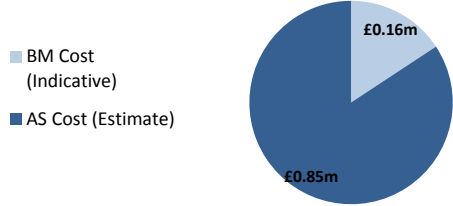

Commentary

600 MW of STOR was run in the morning pick up.
 No trades were required for ROCOF or voltage control or constraints. BM actions were taken in Wales to help reduce output due to a constraint in the area.