
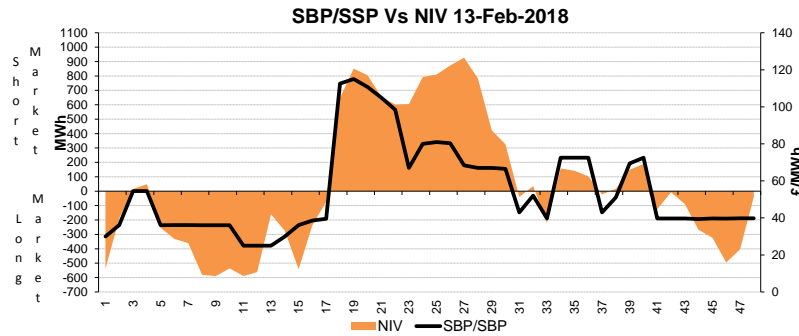
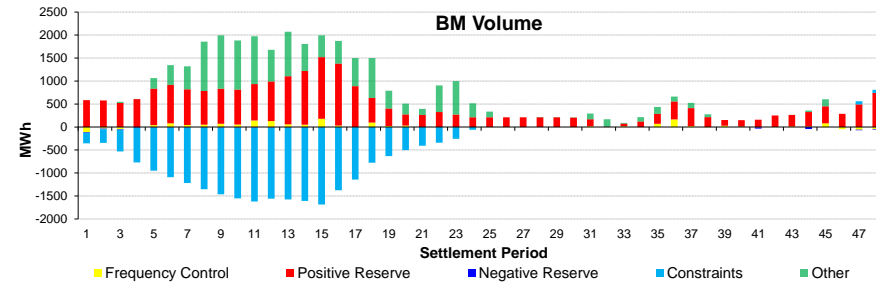
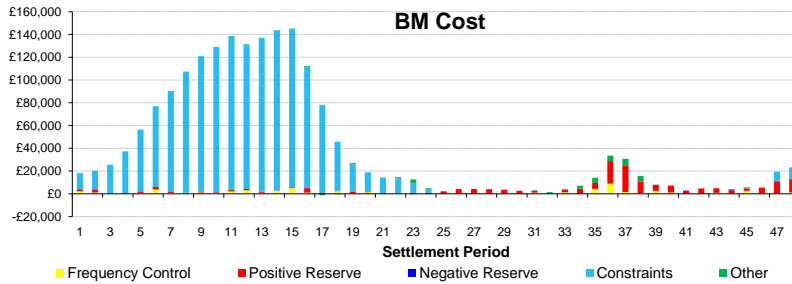
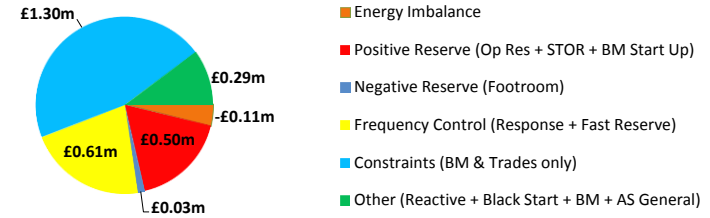


# Daily Balancing Costs

**BSUoS Charge Estimate: £1.90/MWh**  
**Total Outturn: £2.62m**

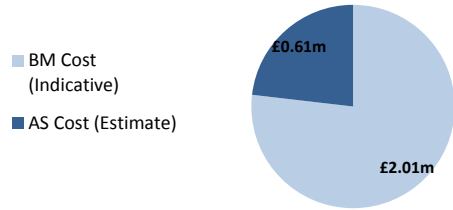

## Commentary

495 MW of STOR was used in the morning pickup. Trades were carried out on the interconnectors for ROCOF and margin. Some BM actions were taken due to too much wind in Scotland to reduce power across the border. Some voltage actions and trades were carried out for voltage support overnight in South Wales and Lincoln.