
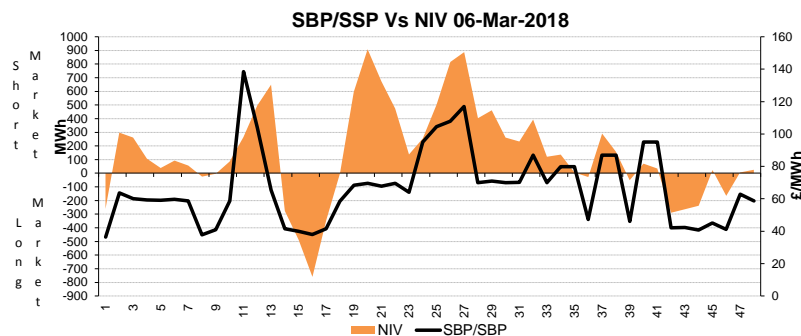
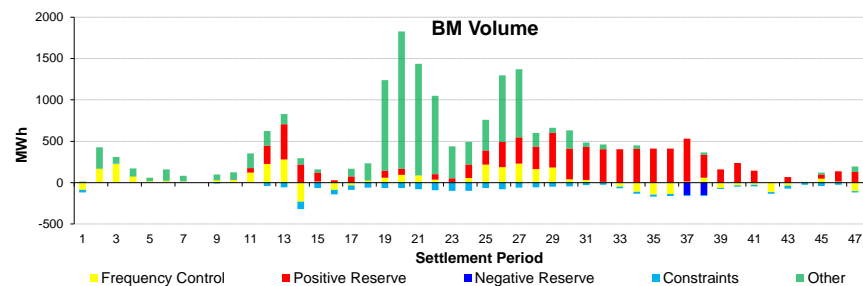
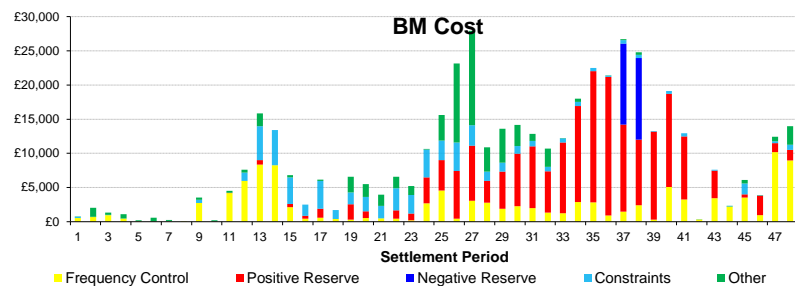
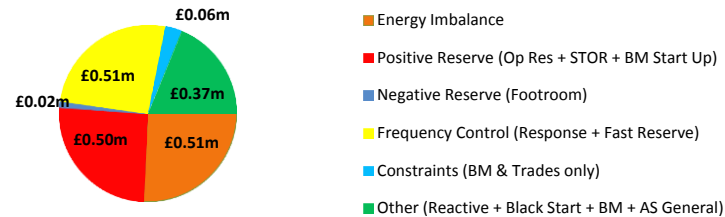


Daily Balancing Costs

Date:

06/03/2018

BSUoS Charge Estimate: £1.35/MWh
Total Outturn: £1.98m

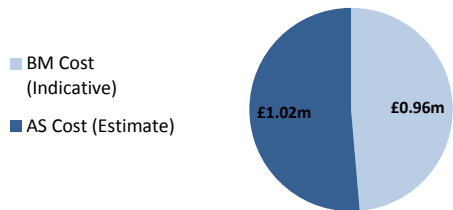

Commentary

377 MW of STOR was run in the morning pickup.
 No trades were required for constraints, Rocof or Voltage. Bm actions were taken on units in Wales throughout the day for a local constraint. Also a machine was bought overnight for voltage control in Wales.