
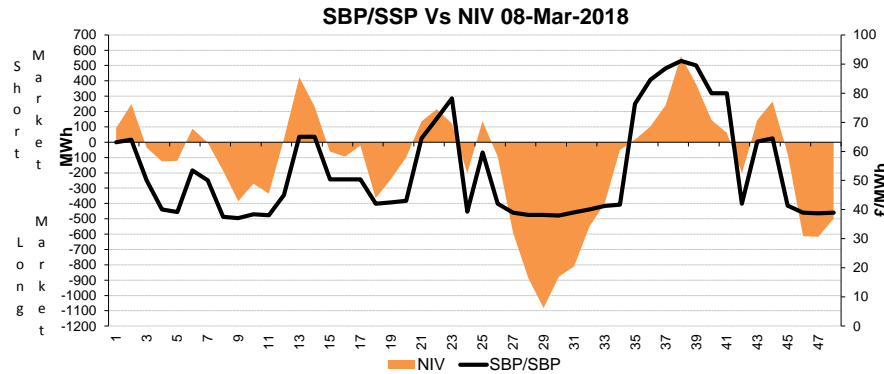
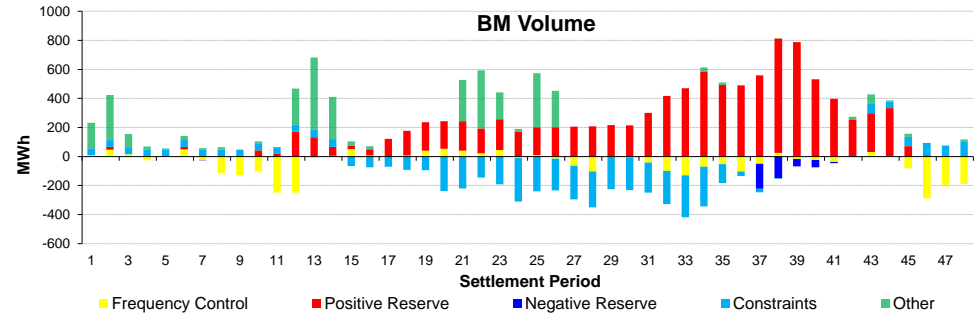
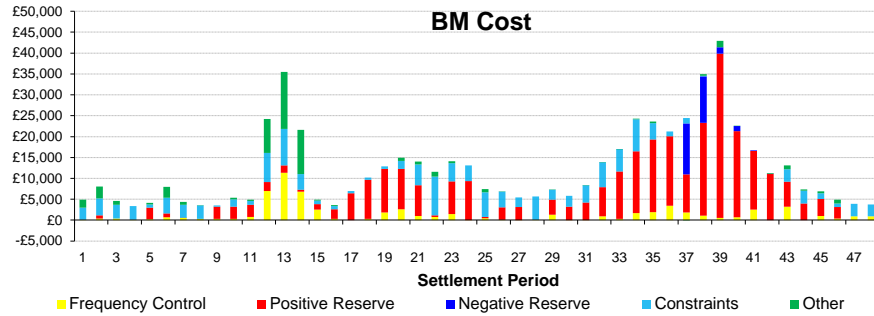
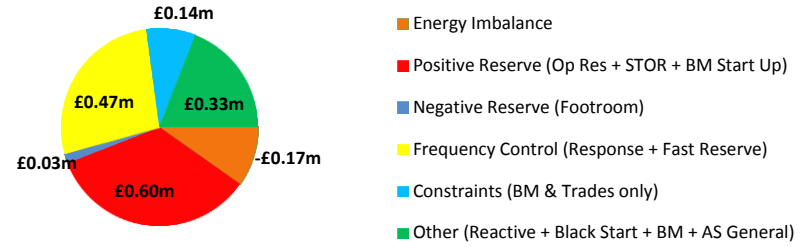


Daily Balancing Costs

BSUoS Charge Estimate: £1.09/MWh
Total Outturn: £1.40m

BM Cost (Indicative)
AS Cost (Estimate)



Commentary

1083MW of STOR was run over the evening peak. One trade was taken for voltage overnight in the North West. No trades were required for constraints or Rocof. BM actions were taken on units in Wales throughout the day for a local constraint. A small number of BM actions were taken on units in the Midlands area due to a overhead line fault.