
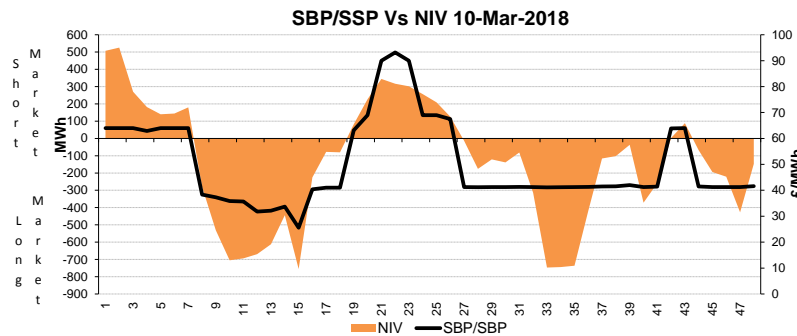
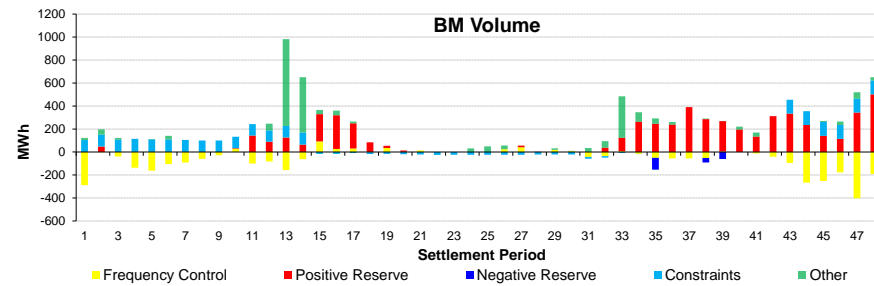
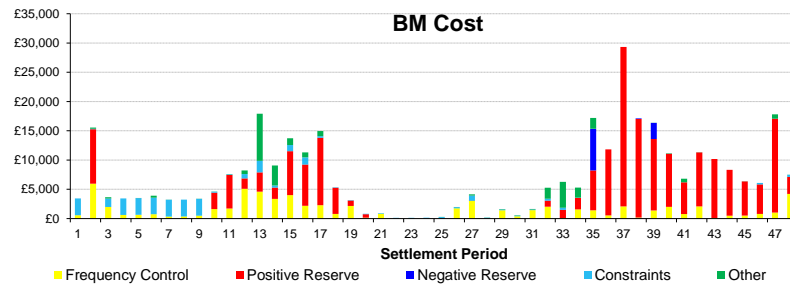
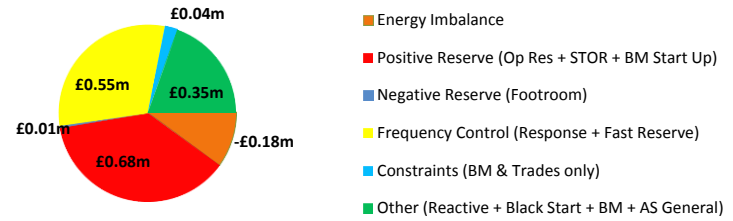


Daily Balancing Costs

BSUoS Charge Estimate: £1.09/MWh
 Total Outturn: £1.44m

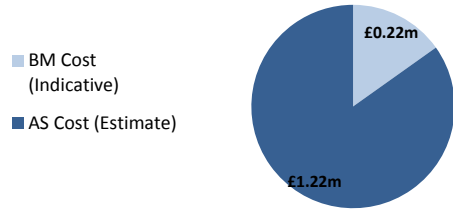

Commentary

761MW of STOR used in the morning pickup. Forecast wind error overnight was up to a 1400MW shortfall (and up to 1GW during the day). A machine in the North was required to run-through overnight to cover part of this shortfall.
 No ROCOF or voltage trades taken. A machine was bought in the market for voltage control in the North.
 Two machines were bid off in the North of Scotland for a constraint.