
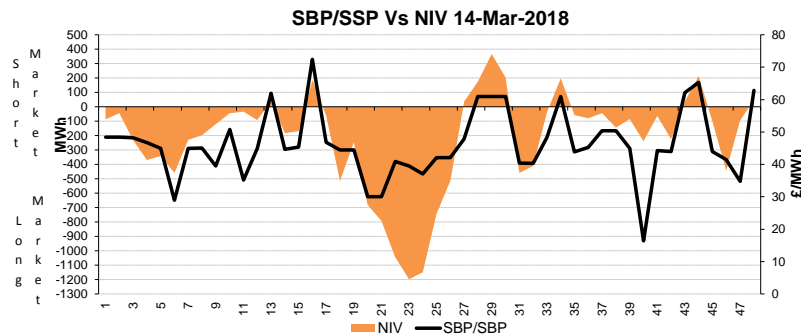
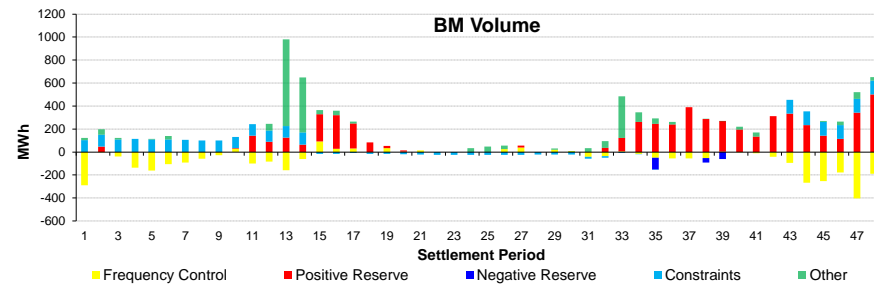
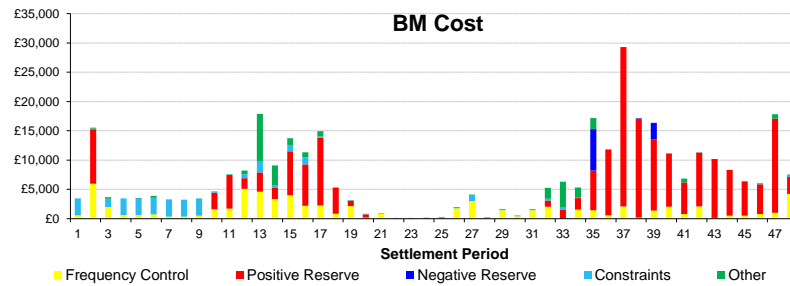
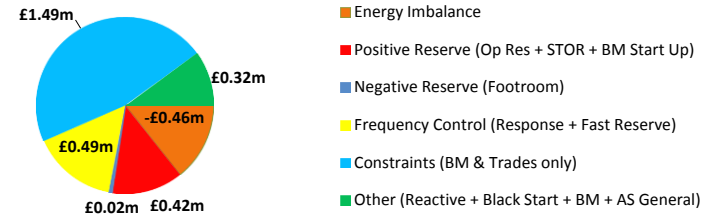


Daily Balancing Costs

BSUoS Charge Estimate: £1.55/MWh
Total Outturn: £2.28m

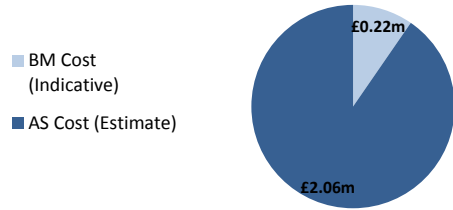

Commentary

Overnight there were trades to reduce the interconnectors by 300 MW for Rocof. 341 MW of STOR was run over the evening peak. Several machines were traded off for constraints in the North due to high wind around 10GW. Machines were bought off in Wales for a constraint.