
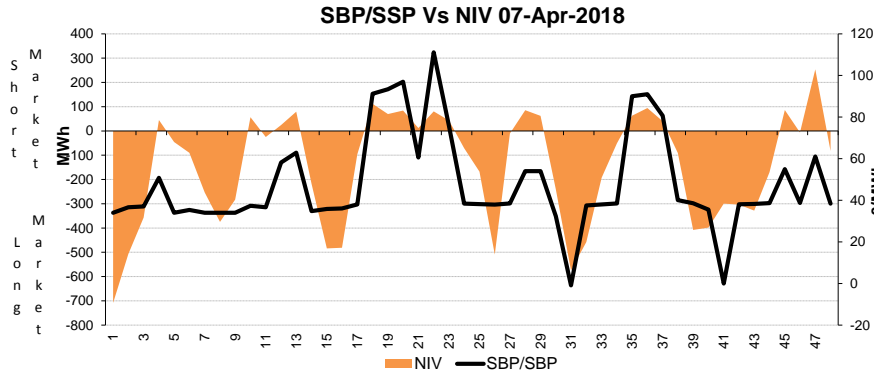
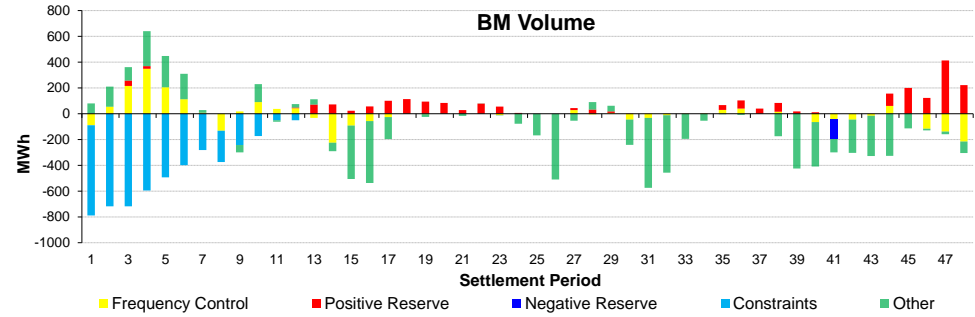
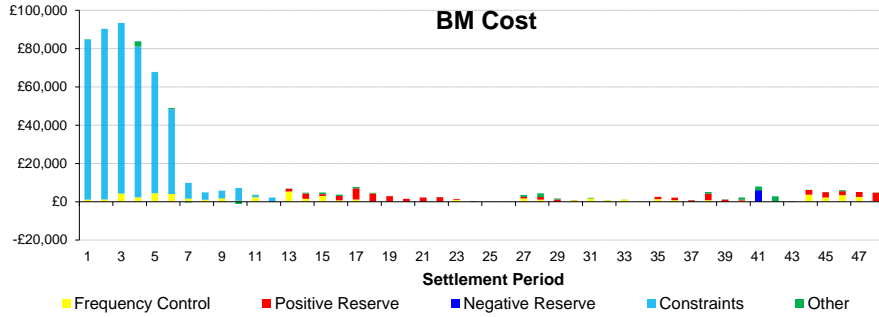
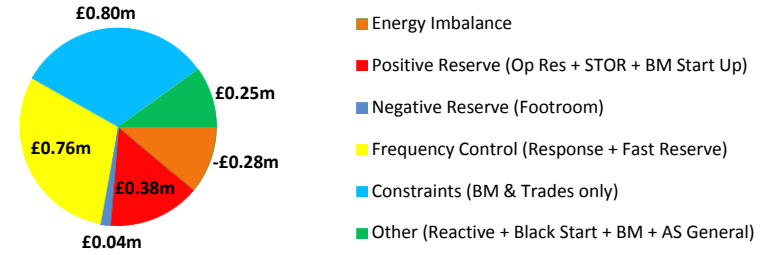


# Daily Balancing Costs

BSUoS Charge Estimate: £1.69/MWh  
Total Outturn: £1.95m

■ BM Cost (Indicative)  
■ AS Cost (Estimate)



## Commentary

491 MW of STOR was run in the morning pick up. Trades were done on the interconnectors for Rocof overnight. Some voltage plant was bought on overnight in the midlands.