



SCHEDULE FOUR

Criteria for Assessing Those Transmission Systems Affected by a Construction Project


SPTL Boundary of Influence to SHETL

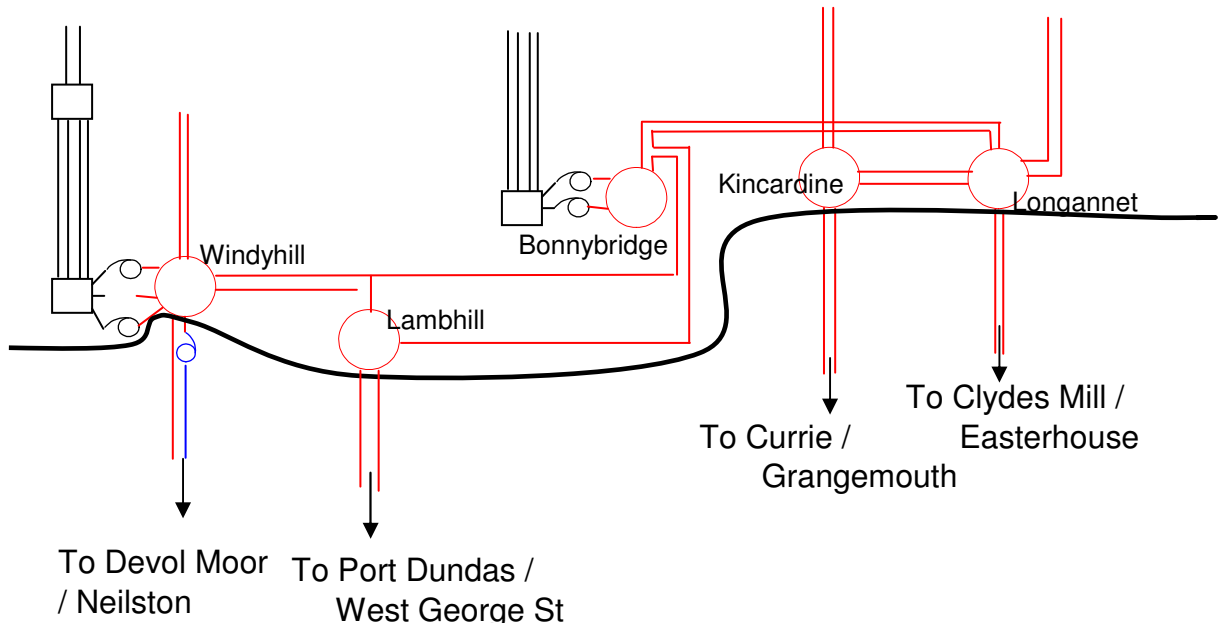

NGET Boundary of Influence to SPTL

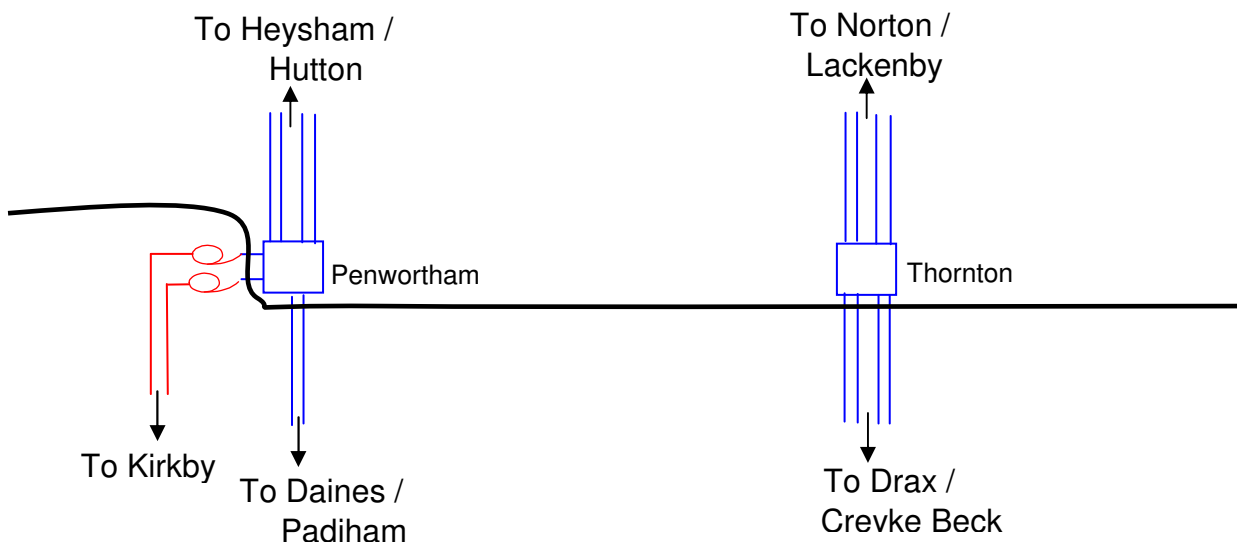

SHETL Boundary of Influence to SPTL

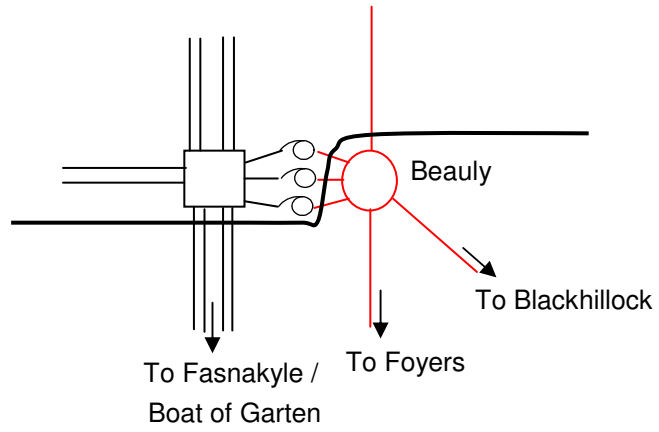

Key

- 400kV
- 275kV
- 132kV